





RR Busduct is part of RR Global, a USD 850+ Million conglomerate in the electrical sector with a presence in over 85 countries globally. Spread across multiple business verticals including Busducts, RR Global has always endeavored to create products of the highest quality using the latest in innovative technology.

RR Busduct's - GUARDEX range of bus way systems is the most comprehensive system in the market as it offers both alternating as well as direct current distribution system and is designed to meet global requirements. Our products also have a high short circuit withstanding capacity with low electromagnetic interference which makes it more efficient. In addition to this, extruded aluminum housing and sandwich construction design makes RR Busduct products robust, compact and one of the lightest sandwich products in the market.

Developed and manufactured at our state-of-the-art facility in Dubai, UAE, we are certified by Intertek for ISO 9001, ISO 14001 and OHSAS 18001. Our products are of the finest quality and accredited by ASTA as per IEC 61439 -1 & 6, IEEE 693 - 2005 standards and by UL as per IEC 60331-1 standard.

We at RR Busduct are technology-driven inspired by innovation, ensuring our customers the most reliable and efficient electrical distribution system.

CONTENTS


01. PHYSICAL DATA	01
02. BUSBAR DIMENSIONS GUARDEX / GUARDEX PLUS	02
03. BUSBAR DIMENSIONS - ALUMINIUM	03
04. HORIZONTAL EXPANSIONS	04
05. JOINT BLOCK	05
06. TECHNICAL DATA OF GUARDEX SANDWICH BUSWAY SYSTEMS	06
07. TECHNICAL DATA GUARDEX - ALUMINIUM CONDUCTOR	07
08. TECHNICAL DATA GUARDEX PLUS - COPPER CONDUCTOR	08
09. BUSBAR SYSTEM	09
10. BUSBAR RISER	10
11. ORDER CODING SYSTEM	11
12. EDGEWISE ELBOWS	12
13. EDGEWISE OFFSETS	13
14. FLATWISE ELBOWS	14
15. FLATWISE OFFSETS	15
16. COMBINATION ELBOW	16
17. FLATWISE TEE	17
18. EXPANSION UNITS	18
19. FLANGES	19
20. COMBINATION FLANGES	20
21. ELBOW FLANGES	21
22. PHASE CROSSOVER UNIT	22
23. REDUCER UNIT	23
24. TAP-OFF BOXES/ CABLE FEED/ CENTER FEED UNITS	24
25. END CAP/ SPRING HANGER	25
26. THE RIGHT PRODUCT AT THE RIGHT PLACE	26
26. CERTIFICATIONS	27-29
27. RR BUSDUCT SYSTEMS SPECIFICATIONS	30- 33

PHYSICAL DATA

STRAIGHT LENGTH (FEEDER)

800Amps ~ 6300 Amps. (Cu.)
800Amps ~ 5000 Amps. (Al.)

- Minimum 400mm - Maximum 4000mm
- Panel to Panel
- Transformer to Panel
- DG to Panel

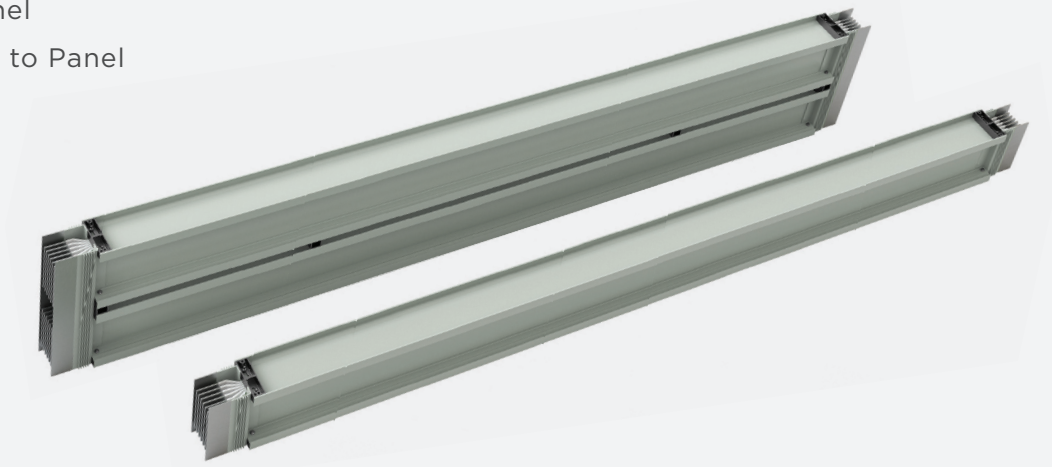

Guardex by RR Busduct is a fully type tested and certified by ASTA UK as per IEC 61439 -1 & 6. Our manufacturing facility is certified by Intertek for quality management system (ISO 9001:2015), Environmental (ISO 14001:2015) & health and safety standard (OHSAS 18001:2007).

Guardex by RR Busduct has been successfully tested for Seismic Zone – 5 compliance as per IEE 693-2005 standards. It is also tested for circuit Integrity for fire rated applications by UL as per IEC 60331-1 for 200 minutes.

STRAIGHT LENGTH (PLUG-IN)

Tap Off Unit Rating	Straight Length (Plug-in) Size	
	Minimum Size (mm)	Maximum Size (mm)
16 A to 100 A	900	4000
125 A to 160 A	1000	4000
200 A to 250 A	1100	4000
300 A to 400 A	1300	4000
500 A to 630 A	1400	4000
800 A to 1000 A	1600	4000

- For tapping power from main line through plug-in boxes.
- Rating and number of plug-in points shall be as per site requirment.




BUSBAR DIMENSIONS - GUARDEX / GUARDEX PLUS

COPPER GUARDEX PLUS

Rating in Amps	Copper size in mm	Dimension W
800	1 x 45(P) x 6	105
1000	1 x 45 x 6	105
1250	1 x 55 x 6	115
1600	1 x 80 x 6	140
2000	1 x 110 x 6	170
2500	1 x 150 x 6	210

COPPER GUARDEX

Rating in Amps	Copper size in mm	Dimension W
800	1 x 50 x 6	110
1000	1 x 60 x 6	120
1250	1 x 70 x 6	130
1400	1 x 80 x 6	140
1400	1 x 100 x 6	160
1600	1 x 100 x 6	160
2000	1 x 125 x 6	185
2000	1 x 150 x 6	210
2500	1 x 200 x 6	260




COPPER GUARDEX PLUS

Rating in Amps	Copper size in mm	Dimension W
3200	2 x 95 x 6	340
4000	2 x 120 x 6	390
5000	2 x 160 x 6	470


COPPER GUARDEX

Rating in Amps	Copper size in mm	Dimension W
2500	2 x 80 x 6	310
3200	2 x 110 x 6	370
4000	2 x 150 x 6	450
5000	2 x 200 x 6	550

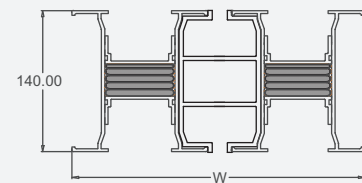


COPPER GUARDEX

Rating in Amps	Copper size in mm	Dimension W
6300	3 x 150 x 6	690

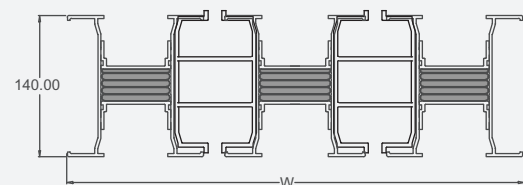


BUSBAR DIMENSIONS - ALUMINIUM


Rating in Amps	Aluminium size in mm	Dimension W
800	1 x 60 x 6	120
1000	1 x 80 x 6	140
1250	1 x 110 x 6	170
1600	1 x 150 x 6	210
2000	1 x 200 x 6	260



Rating in Amps	Aluminium size in mm	Dimension W
2500	2 x 125x 6	400
3200	2 x 150 x 6	450
4000	2 x 200 x 6	550

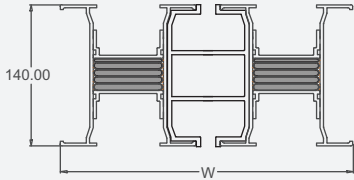


Rating in Amps	Aluminium size in mm	Dimension W
5000	3 x 200x 6	840

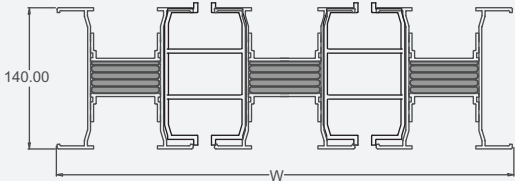


HORIZONTAL EXPANSIONS

- Horizontal Expansion Joint should be utilized if Busbar line is crossing in an adjacent manner through building expansion joints.
- Expansion unit is IP55 for all ratings.
- RR Busduct requests to be consulted during design stage
- Total length of the module should be adjusted to 1500mm, after Busbar installation.

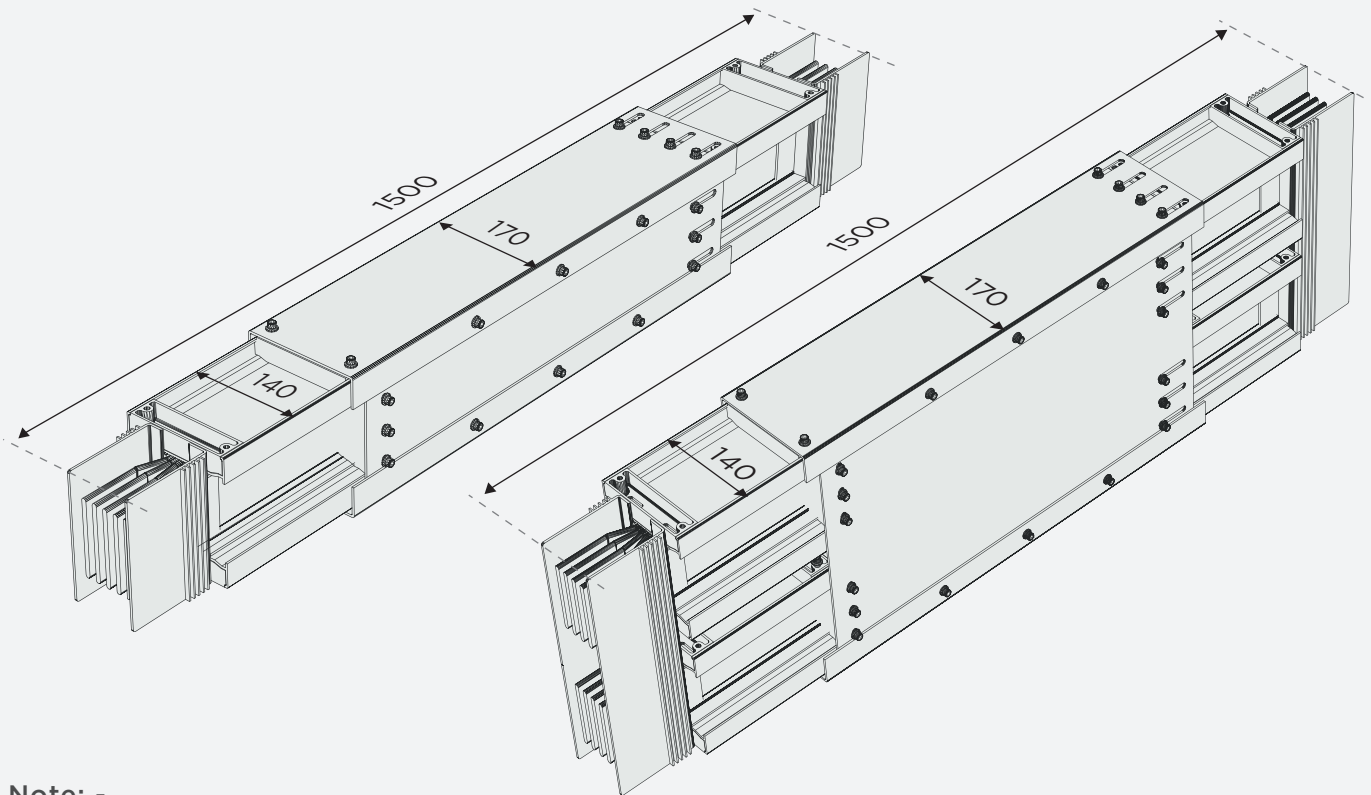


Note: -

The total length of the module should be adjusted to 1500mm, after busbar installation.

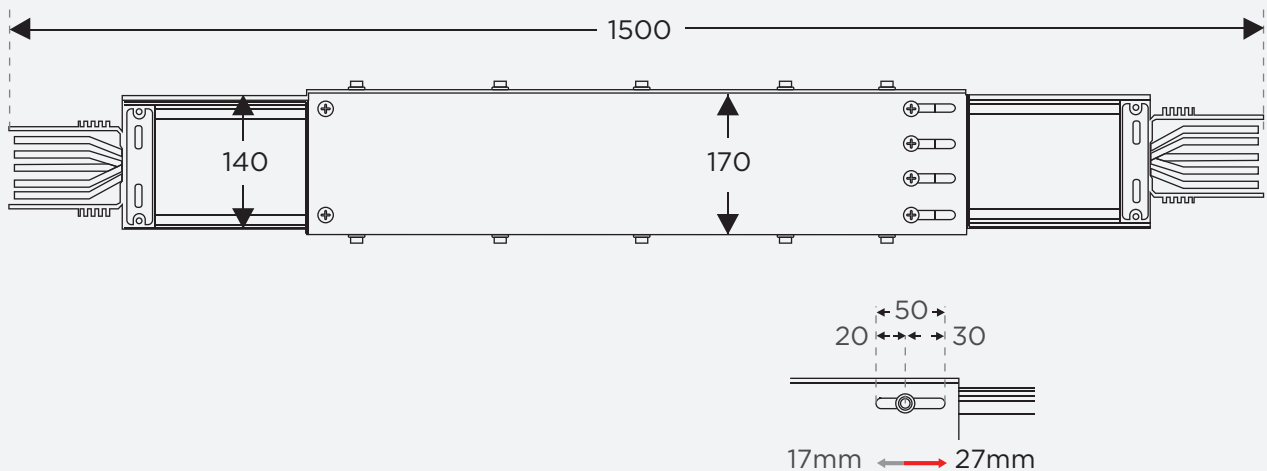

JOINT BLOCK

- The joint block is used to connect two elements of the busbar systems, it can be fitted or removed in an installed condition without the removal of the adjacent sections or elements.
- The torque nut ensures tightness of joints at desired torque and eliminates the need of torque wrench during the installation process.
- Heavy duty side plates and Belleville washers ensures uniform distribution of pressure. Joints can be tightened easily with the help of a spanner only on one side.

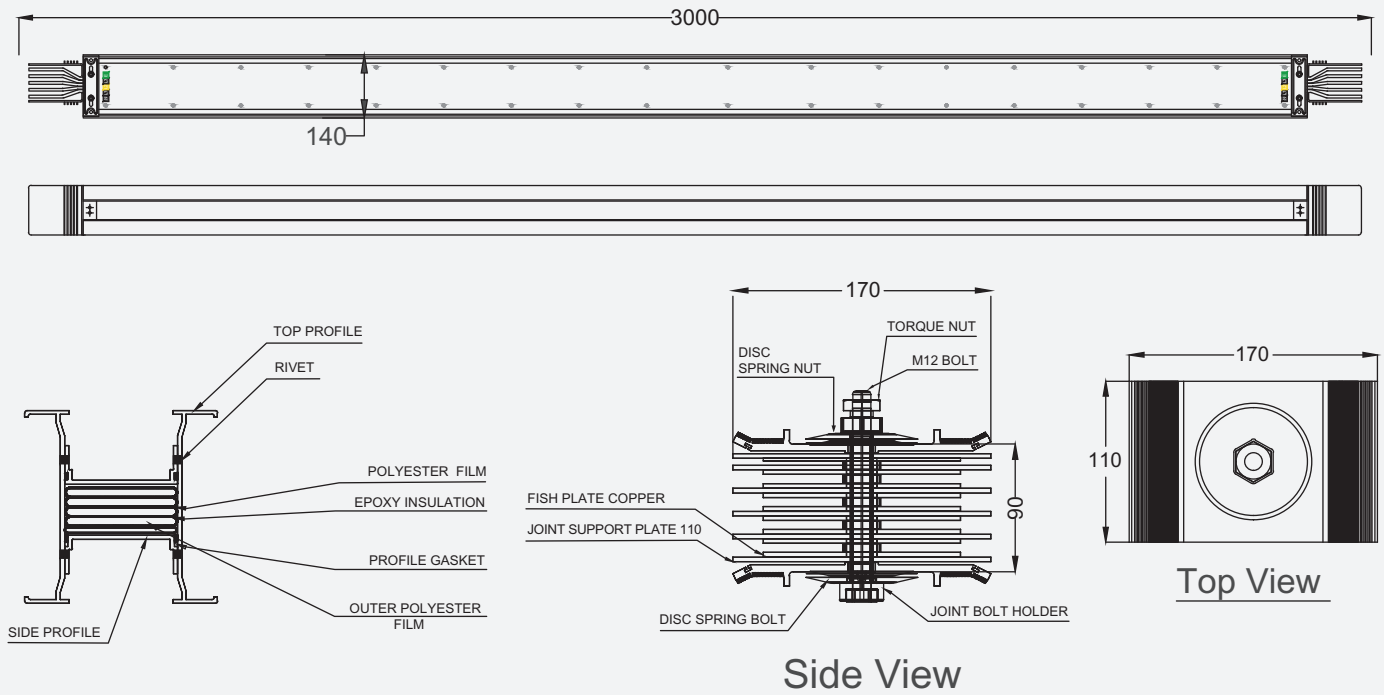

BUS BAR INSULATION DETAILS

The compact structure is considered as the 'perfect' design for high current busduct systems, which means Busbar conductors are tin plated and insulated with class F polyester film and are epoxy coated.

Construction of sandwich design in extruded aluminum makes the system efficient with low hysteresis losses and better heat dissipation. There is no space filled with air and heat is easily transferred to the environment by the housing that works like a heat dissipater.


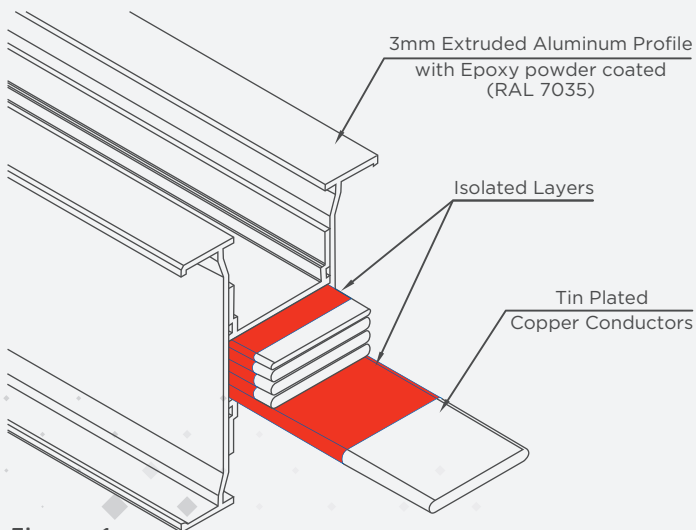


Figure 2

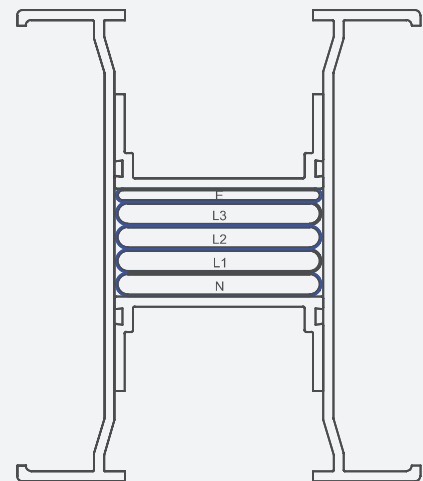

Technical Data of Guardex Sandwich Busway Systems

Copper Conductor (Cu)

Standards	IEC 61439-6 / 1																	
Rated Insulation Voltage	Ui 1000 V																	
Rated Operational Voltage	Ue 1000 V																	
Rated Impulse Withstand Voltage	Uimp 8 kV																	
Rated Frequency	fn 50/60 Hz																	
Pollution Degree	III																	
Protection Degree	IP54 / IP55 / IP65 / IP67																	
External Mechanical Impacts (IK Code)	IK10																	
Rated Current In	Ampere		800	1000	1250	1400	1600	1400	2000	2000	2500	2000	2500	3000	3200	4000	5000	6300
Rated Short-time Withstand Current (Is) 3φ	I _{cw}	kA	50	50	50	50	80	80	80	80	100	80	80	80	120	120	120	120
Rated Peak Withstand Current	I _{pk}	kA	105	105	105	105	176	176	176	176	220	176	176	176	264	264	264	264
Rated Short-time Withstand Current for Neutral (Is) 1φ	I _{cw}	kA	30	30	30	30	48	48	48	48	60	48	48	48	72	72	72	72
Rated Peak Withstand Current for Neutral	I _{pk}	kA	63	63	63	63	105.6	105.6	105.6	105.6	132	105.6	105.6	105.6	158.4	158.4	158.4	158.4
Rated Short-time Withstand Current for PE Conductor (Is) 1φ	I _{cw}	kA	30	30	30	30	48	48	48	48	60	48	48	48	72	72	72	72
Rated Peak Withstand Current for PE Conductor	I _{pk}	kA	63	63	63	63	105.6	105.6	105.6	105.6	132	105.6	105.6	105.6	158.4	158.4	158.4	158.4

Cross Section

L1 L2 L3 N	mm²		300	360	420	480	600	660	750	900	960	1050	1200	1380	1320	1800	2400	2700
Internal Earth (50%)	mm²		150	180	210	240	300	330	375	450	480	525	600	690	660	900	1200	1350
Internal Earth (100%)	mm²		300	360	420	480	600	660	750	900	960	1050	1200	1380	1320	1800	2400	2700
Aluminium Housing Cross Section	mm²		1856	1916	1976	2036	2156	2278	2306	2456	4072	2607	4072	2930	4432	4912	5512	7368
Overall Dimension	WxH		110x140	120x140	130x140	140x140	160x140	170x140	185x140	210x140	310x140	235x140	260x140	270x140	370x140	450x140	550x140	690x140

Weight / Meter

Busbar Trunking Weight (4 Conductors)	kg/m		16.2	17.9	20.1	23.9	27.3	32.2	34.2	42.7	46.7	48.1	55.8	54.4	59.1	79	102.4	110.5
Busbar Trunking Weight (4.5 Conductors)	kg/m		17.5	19.5	22	26	30	35.1	37.5	46.7	51	52.7	61.1	60.5	65	87	113	122.5
Busbar Trunking Weight (5 Conductors)	kg/m		18.8	21.1	23.9	28.1	32.7	38	40.8	50.7	55.3	57.4	66.4	66.6	70.9	95	123.6	134.5

Mean Phase Conductor Characteristics At Rated Current In

Resistance at a conductor temp of 20 °C	R ₂₀	mΩ/m	0.0582	0.042	0.038	0.033	0.024	0.0236	0.022	0.0195	0.0182	0.0178	0.0165	0.016	0.012	0.009	0.0081	0.0064
Resistance at an ambient air temp of 50 °C	R	mΩ/m	0.0651	0.0470	0.0425	0.0369	0.0268	0.0264	0.0246	0.0218	0.0203	0.0199	0.0184	0.0179	0.0134	0.0101	0.0091	0.0072
Reactance (Independent from temp)	X	mΩ/m	0.025	0.024	0.02	0.018	0.014	0.012	0.009	0.008	0.007	0.007	0.006	0.006	0.005	0.004	0.0034	0.003
(+) & (-) sequence impedances at an ambient air temp of 50 °C	Z	mΩ/m	0.0972	0.0652	0.1030	0.0591	0.0584	0.0522	0.0412	0.0381	0.0337	0.0302	0.0335	0.0058	0.0251	0.0333	0.0313	0.0298
(+) & (-) sequence impedances at a conductor temp of 20 °C	Z ₂₀	mΩ/m	0.0857	0.0575	0.0909	0.0522	0.0636	0.0460	0.0364	0.0336	0.0297	0.0266	0.0296	0.0051	0.0221	0.0294	0.0276	0.0263

Voltage Drop / Ampere / Meter

Voltage Drop mV at 1.0 Power Factor	mV/A/m		0.0504	0.0364	0.0329	0.0286	0.0208	0.0204	0.0191	0.0169	0.0158	0.0154	0.0143	0.0139	0.0104	0.0078	0.0070	0.0055
Voltage Drop mV at 0.9 Power Factor	mV/A/m		0.0548	0.0418	0.0372	0.0325	0.0240	0.0229	0.0205	0.0182	0.0168	0.0165	0.0151	0.0147	0.0112	0.0085	0.0076	0.0061
Voltage Drop mV at 0.8 Power Factor	mV/A/m		0.0533	0.0416	0.0367	0.0322	0.0239	0.0226	0.0199	0.0177	0.0162	0.0160	0.0145	0.0142	0.0109	0.0083	0.0074	0.0060
Voltage Drop mV at 0.7 Power Factor	mV/A/m		0.0507	0.0403	0.0354	0.0311	0.0232	0.0217	0.0189	0.0168	0.0154	0.0151	0.0137	0.0134	0.0104	0.0079	0.0070	0.0057
Voltage Drop mV at 0.6 Power Factor	mV/A/m		0.0476	0.0385	0.0336	0.0296	0.0222	0.0206	0.0177	0.0157	0.0143	0.0141	0.0127	0.0125	0.0097	0.0074	0.0066	0.0054
Voltage Drop mV at 0.5 Power Factor	mV/A/m		0.0439	0.0362	0.0315	0.0278	0.0209	0.0192	0.0163	0.0144	0.0131	0.0130	0.0116	0.0114	0.0089	0.0069	0.0061	0.0050

Voltage Drop / Meter

Voltage Drop mV at 1.0 Power Factor	V/m		0.0403	0.0364	0.0411	0.0400	0.0333	0.0286	0.0381	0.0338	0.0394	0.0385	0.0357	0.0416	0.0333	0.0312	0.0351	0.0349
Voltage Drop mV at 0.9 Power Factor	V/m		0.0438	0.0418	0.0465	0.0455	0.0384	0.0321	0.0411	0.0364	0.0421	0.0413	0.0378	0.0442	0.0360	0.0341	0.0380	0.0386
Voltage Drop mV at 0.8 Power Factor	V/m		0.0426	0.0416	0.0459	0.0451	0.0382	0.0316	0.0398	0.0353	0.0406	0.0399	0.0364	0.0426	0.0349	0.0333	0.0369	0.0378
Voltage Drop mV at 0.7 Power Factor	V/m		0.0406	0.0403	0.0443	0.0436	0.0371	0.0304	0.0378	0.0335	0.0384	0.0378	0.0343	0.0402	0.0332	0.0317	0.0351	0.0361
Voltage Drop mV at 0.6 Power Factor	V/m		0.0380	0.0385	0.0420	0.0415	0.0355	0.0288	0.0353	0.0313	0.0358	0.0352	0.0318	0.0374	0.0310	0.0298	0.0328	0.0340
Voltage Drop mV at 0.5 Power Factor	V/m		0.0352	0.0362	0.0393	0.0389	0.0334	0.0269	0.0326	0.0289	0.0328	0.0324	0.0291	0.0343	0.0286	0.0276	0.0303	0.0316

Technical Data of Guardex Sandwich Busway Systems

Aluminium Conductor (Al)

Standards	IEC 61439-6 / 1									
Rated Insulation Voltage	Ui 1000 V									
Rated Operational Voltage	Ue 1000 V									
Rated Impulse Withstand Voltage	Uimp 8 kV									
Rated Frequency	fn 50/60 Hz									
Pollution Degree	III									
Protection Degree	IP54 / IP55 / IP65 / IP67									
External Mechanical Impacts (IK Code)	IK10									
Rated Current In	Ampere	800	1000	1250	1600	2000	2500	3200	4000	5000
Rated Short-time Withstand Current (1s) 3φ	I _{cw} kA	36	50	50	50	80	100	100	100	100
Rated Peak Withstand Current	I _{pk} kA	76	105	105	105	176	220	220	220	220
Rated Short-time Withstand Current for Neutral (1s) 1φ	I _{cw} kA	36	50	50	50	80	100	100	100	100
Rated Peak Withstand Current for Neutral	I _{pk} kA	76	105	105	105	176	220	220	220	220
Rated Short-time Withstand Current for PE Conductor (1s) 1φ	I _{cw} kA	21.6	30	30	30	48	60	60	60	60
Rated Peak Withstand Current for PE Conductor	I _{pk} kA	45.6	63	63	63	105.6	132	132	132	132

Cross Section

L1 L2 L3 N	mm ²	360	480	660	900	1200	1500	1800	2400	3600
Internal Earth (100%)	mm ²	360	480	660	900	1200	1500	1800	2400	3600
Aluminium Housing Cross Section	mm ²	1916	2036	2216	2456	2756	4612	4912	5512	7932
Overall Dimension	WxH	120x140	140x140	170x140	210x140	260x140	400x140	450x140	550x140	840x140

Weight / Meter

Busbar Trunking Weight (4 Conductors)	kg/m	kg/m	9	11	13	16	20	29	33	49	62
Busbar Trunking Weight (5 Conductors)	kg/m	kg/m	10	12.5	15	18.5	23	33	38	55	71

Mean Phase Conductor Characteristics At Rated Current In

Resistance at a conductor temp of 20 °C	R ₂₀	mΩ/m	0.0155	0.0099	0.0071	0.0039	0.0057	0.0024	0.0016	0.0015	0.0001
Resistance at an ambient air temp of 80 °C	R	mΩ/m	0.0201	0.0127	0.0091	0.0051	0.0076	0.0030	0.0021	0.0020	0.0012
Reactance (Independent from temp)	X	mΩ/m	0.0741	0.0698	0.0564	0.0444	0.0371	0.0323	0.0296	0.0237	0.0189
(+) & (-) sequence impedances at an ambient air temp of 20 °C	Z ₂₀	mΩ/m	0.0766	0.0705	0.0568	0.0446	0.0375	0.3240	0.0297	0.0238	0.0190
(+) & (-) sequence impedances at a conductor temp of 35 °C	Z ₃₅	mΩ/m	0.0757	0.0709	0.0571	0.0447	0.0378	0.0326	0.0298	0.0239	0.0191

Voltage Drop / Ampere / Meter

Voltage Drop mV at 1.0 Power Factor	mV/A/m	0.0348	0.0220	0.0158	0.0088	0.0132	0.0052	0.0036	0.0035	0.0021
Voltage Drop mV at 0.9 Power Factor	mV/A/m	0.0873	0.0725	0.0568	0.0415	0.0399	0.0291	0.0256	0.0210	0.0161
Voltage Drop mV at 0.8 Power Factor	mV/A/m	0.1049	0.0901	0.0712	0.0532	0.0491	0.0377	0.0337	0.0274	0.0213
Voltage Drop mV at 0.7 Power Factor	mV/A/m	0.1160	0.1017	0.0808	0.0611	0.0551	0.0436	0.0392	0.0317	0.0248
Voltage Drop mV at 0.6 Power Factor	mV/A/m	0.1236	0.1099	0.0876	0.0668	0.0593	0.0479	0.0432	0.0349	0.0274
Voltage Drop mV at 0.5 Power Factor	mV/A/m	0.1286	0.1157	0.0925	0.0710	0.0622	0.0510	0.0462	0.0373	0.0294

Voltage Drop / Meter

Voltage Drop V/m at 1.0 Power Factor	V/m	0.0279	0.0220	0.0197	0.0141	0.0263	0.0130	0.0116	0.0139	0.0104
Voltage Drop V/m at 0.9 Power Factor	V/m	0.0698	0.0725	0.0710	0.0664	0.0797	0.0727	0.0820	0.0840	0.0807
Voltage Drop V/m at 0.8 Power Factor	V/m	0.0839	0.0901	0.0890	0.0851	0.0982	0.0943	0.1077	0.1096	0.1065
Voltage Drop V/m at 0.7 Power Factor	V/m	0.0928	0.1017	0.1010	0.0978	0.1102	0.1090	0.1253	0.1270	0.1242
Voltage Drop V/m at 0.6 Power Factor	V/m	0.0989	0.1099	0.1095	0.1069	0.1186	0.1197	0.1382	0.1397	0.1372
Voltage Drop V/m at 0.5 Power Factor	V/m	0.1028	0.1157	0.1156	0.1136	0.1245	0.1276	0.1479	0.1491	0.1469

Technical Data of Guardex Plus Sandwich Busway Systems

Copper Conductor (Cu)

Standards	IEC 61439-6 / 1										
Rated Insulation Voltage	Ui 1000 V										
Rated Operational Voltage	Ue 1000 V										
Rated Impulse Withstand Voltage	Uimp 8 kV										
Rated Frequency	fn 50/60 Hz										
Pollution Degree	III										
Protection Degree	IP54 / IP55 / IP65										
External Mechanical Impacts (IK Code)	IK10										
Rated Current In	Ampere		800	1000	1250	1600	2000	2500	3200	4000	5000
Rated Short-time Withstand Current (1s) 3φ	I _{cw}	kA	50*	50**	50	50	80	100	100	120	120
Rated Peak Withstand Current	I _{pk}	kA	105	105	105	105	176	176	220	264	264
Rated Short-time Withstand Current for Neutral (1s) 1φ	I _{cw}	kA	30	30	30	30	48	48	60	72	72
Rated Peak Withstand Current for Neutral	I _{pk}	kA	63	63	63	63	105.6	105.6	132	158.4	158.4
Rated Short-time Withstand Current for PE Conductor (1s) 1φ	I _{cw}	kA	30	30	30	30	48	48	60	72	72
Rated Peak Withstand Current for PE Conductor	I _{pk}	kA	63	63	63	63	105.6	105.6	132	158.4	158.4

Cross Section

L1 L2 L3 N	mm ²		210	270	330	480	660	900	1140	1440	1920
Internal Earth (50%)	mm ²		135	135	165	240	330	450	570	720	960
Internal Earth (100%)	mm ²		210	210	330	480	660	900	1140	1440	1920
Aluminium Housing Cross Section	mm ²		1785	1785	1865	2018	2258	2456	4363	4719	5119
Overall Dimension	WxH		105x140	105x140	115x140	140x140	170x140	210x140	340x140	390x140	470x140

Weight / Meter

Busbar Trunking Weight (4 Conductors)	kg/m		12.8	14.9	17.3	23.0	30.1	41.2	52.9	64.5	82.7
Busbar Trunking Weight (4.5 Conductors)	kg/m		13.7	16.5	18.8	25.2	33.0	45.0	57.9	70.9	91.2
Busbar Trunking Weight (5 Conductors)	kg/m		14.7	17.3	20.2	27.3	36.0	48.7	63.0	77.3	99.8

Mean Phase Conductor Characteristics At Rated Current In

Resistance at a conductor temp of 20 °C	R ₂₀	mΩ/m	0.08528	0.05746	0.04434	0.03047	0.02319	0.0201	0.01305	0.01201	0.009
Resistance at an ambient air temp of 50 °C (IEC mtd)	R ₅₀	mΩ/m	0.1116	0.0788	0.0596	0.0420	0.0317	0.0279	0.0174	0.0163	0.0121
Reactance (Independent from temp)	X	mΩ/m	0.02469	0.02529	0.01808	0.01283	0.01273	0.00876	0.00665	0.00566	0.00409
(+) & (-) sequence impedances at an ambient air temp of 50 °C	Z	mΩ/m	0.5429	0.4222	0.3195	0.2078	0.1363	0.1206	0.0968	0.0685	0.0570
(+) & (-) sequence impedances at a conductor temp of 20 °C	Z ₂₀	mΩ/m	0.4860	0.3780	0.2860	0.1860	0.1220	0.1080	0.0867	0.0613	0.0510

Voltage Drop / Ampere / Meter

Voltage Drop mV at 1.0 Power Factor	mV/A/m		0.0967	0.0682	0.0516	0.0364	0.0275	0.0242	0.0151	0.0141	0.0105
Voltage Drop mV at 0.9 Power Factor	mV/A/m		0.0963	0.0710	0.0533	0.0376	0.0295	0.0251	0.0161	0.0148	0.0110
Voltage Drop mV at 0.8 Power Factor	mV/A/m		0.0902	0.0677	0.0507	0.0358	0.0286	0.0239	0.0155	0.0142	0.0105
Voltage Drop mV at 0.7 Power Factor	mV/A/m		0.0829	0.0634	0.0473	0.0334	0.0271	0.0223	0.0147	0.0134	0.0099
Voltage Drop mV at 0.6 Power Factor	mV/A/m		0.0751	0.0585	0.0435	0.0307	0.0253	0.0206	0.0136	0.0124	0.0091
Voltage Drop mV at 0.5 Power Factor	mV/A/m		0.0669	0.0531	0.0394	0.0278	0.0233	0.0187	0.0125	0.0113	0.0083

Voltage Drop / Meter

Voltage Drop V/m at 1.0 Power Factor	V/m		0.0773	0.0682	0.0645	0.0582	0.0549	0.0605	0.0482	0.0563	0.0525
Voltage Drop V/m at 0.9 Power Factor	V/m		0.0771	0.0710	0.0666	0.0601	0.0590	0.0627	0.0514	0.0593	0.0550
Voltage Drop V/m at 0.8 Power Factor	V/m		0.0721	0.0677	0.0634	0.0572	0.0572	0.0597	0.0496	0.0568	0.0527
Voltage Drop V/m at 0.7 Power Factor	V/m		0.0664	0.0634	0.0591	0.0534	0.0542	0.0559	0.0469	0.0534	0.0494
Voltage Drop V/m at 0.6 Power Factor	V/m		0.0601	0.0585	0.0544	0.0491	0.0506	0.0514	0.0437	0.0495	0.0457
Voltage Drop V/m at 0.5 Power Factor	V/m		0.0535	0.0531	0.0492	0.0445	0.0465	0.0467	0.0401	0.0452	0.0416

* - Short circuit duration for 0.1 sec
**- Short Circuit duration for 0.5 sec

BUSBAR SYSTEM


Introduction

Guardex by RR Busduct is the most comprehensive system to meet the requirement of a global market. Our system is suitable for alternate current and direct current distribution. Current ratings offered are from 800A to 6300A. Rated operational voltage up to 1000V, IP degree up to IP 67 and frequency 50/60 Hz.

Construction of the sandwich design in extruded aluminum housing makes the system efficient with low hysteresis losses and better heat dissipation.


Advantages of the RR Busducts over Cable

- Low installation cost.
- Scope for future expansion.
- Modern & Aesthetic look.
- Better voltage regulation.
- Robust & Compact.
- Higher short circuit withstand capacities.
- No electromagnetic interference.
- Higher over load capacities.

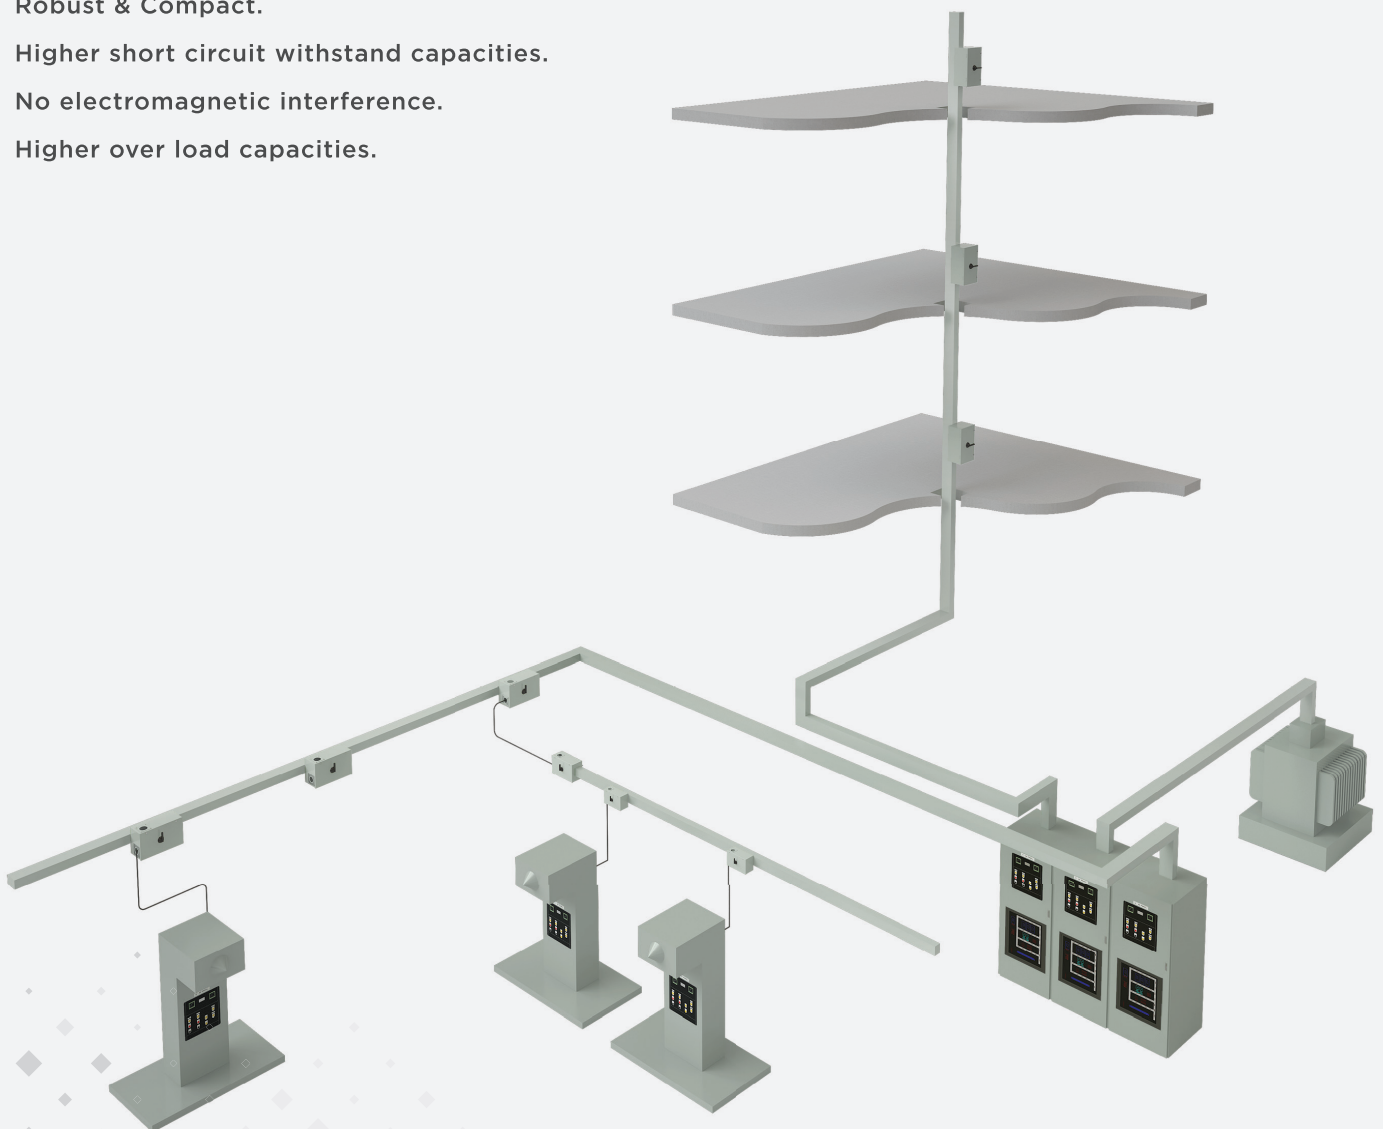


BUSBAR RISER

RR Busduct Busbar riser is designed according to the structure of the building and requires less space compared to cables.

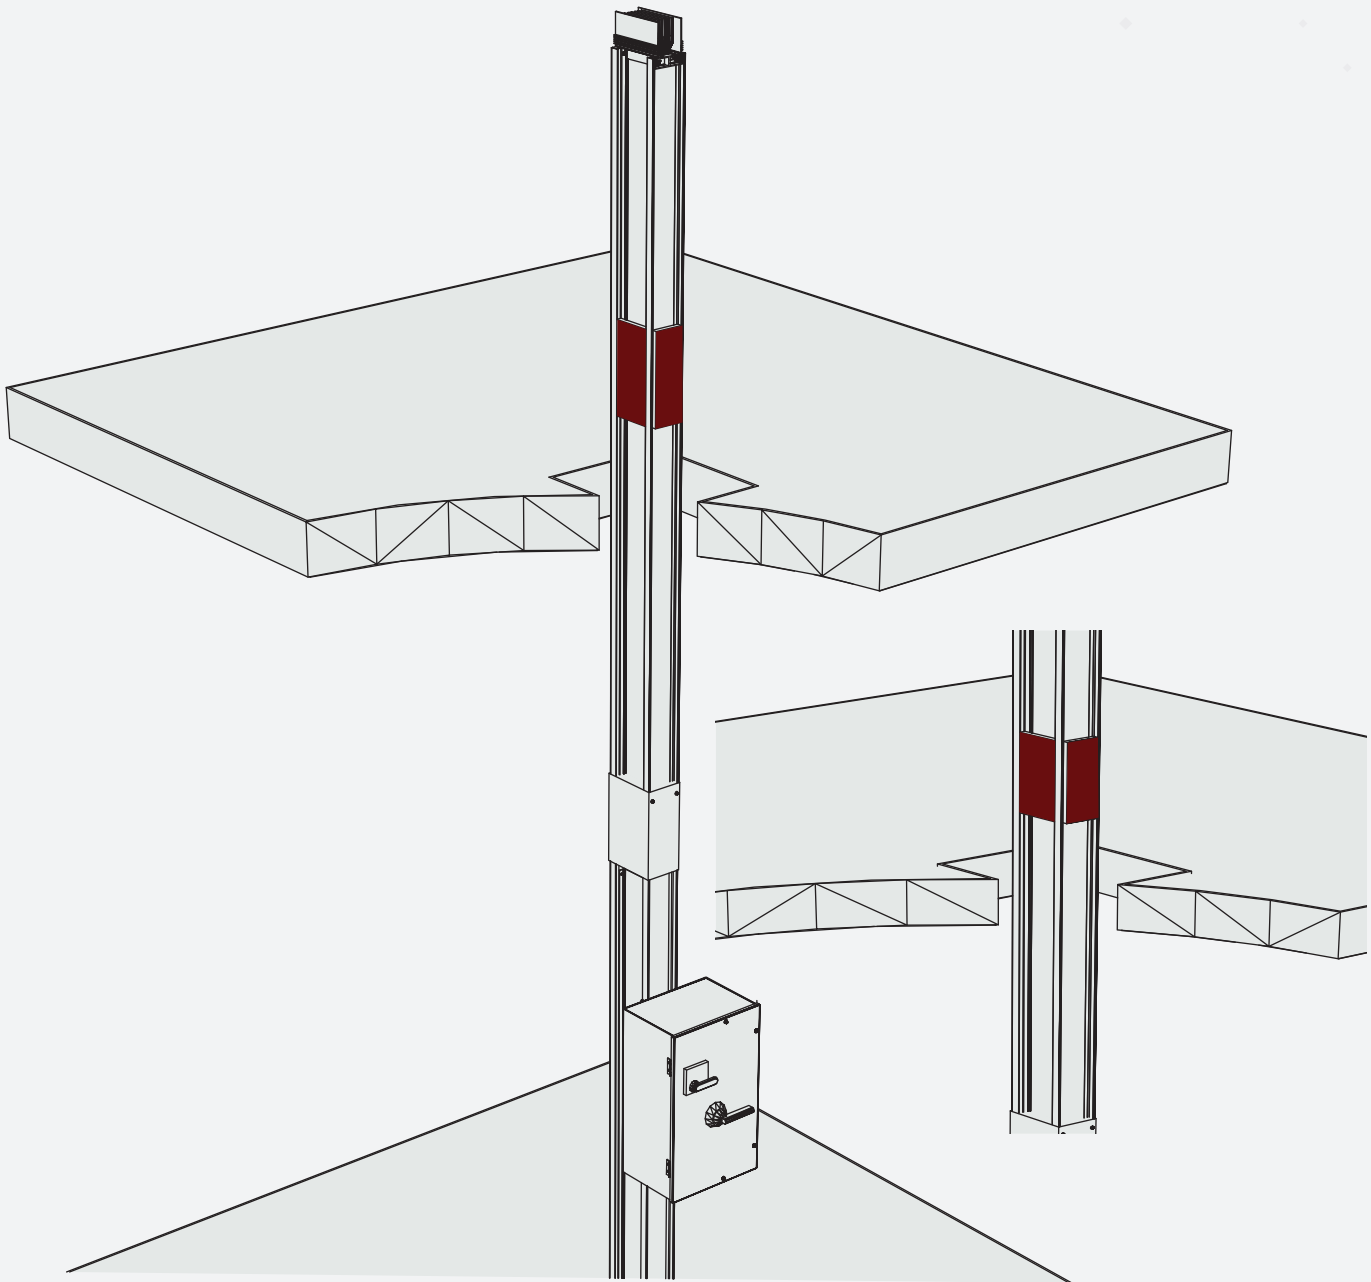


ORDER CODING SYSTEM

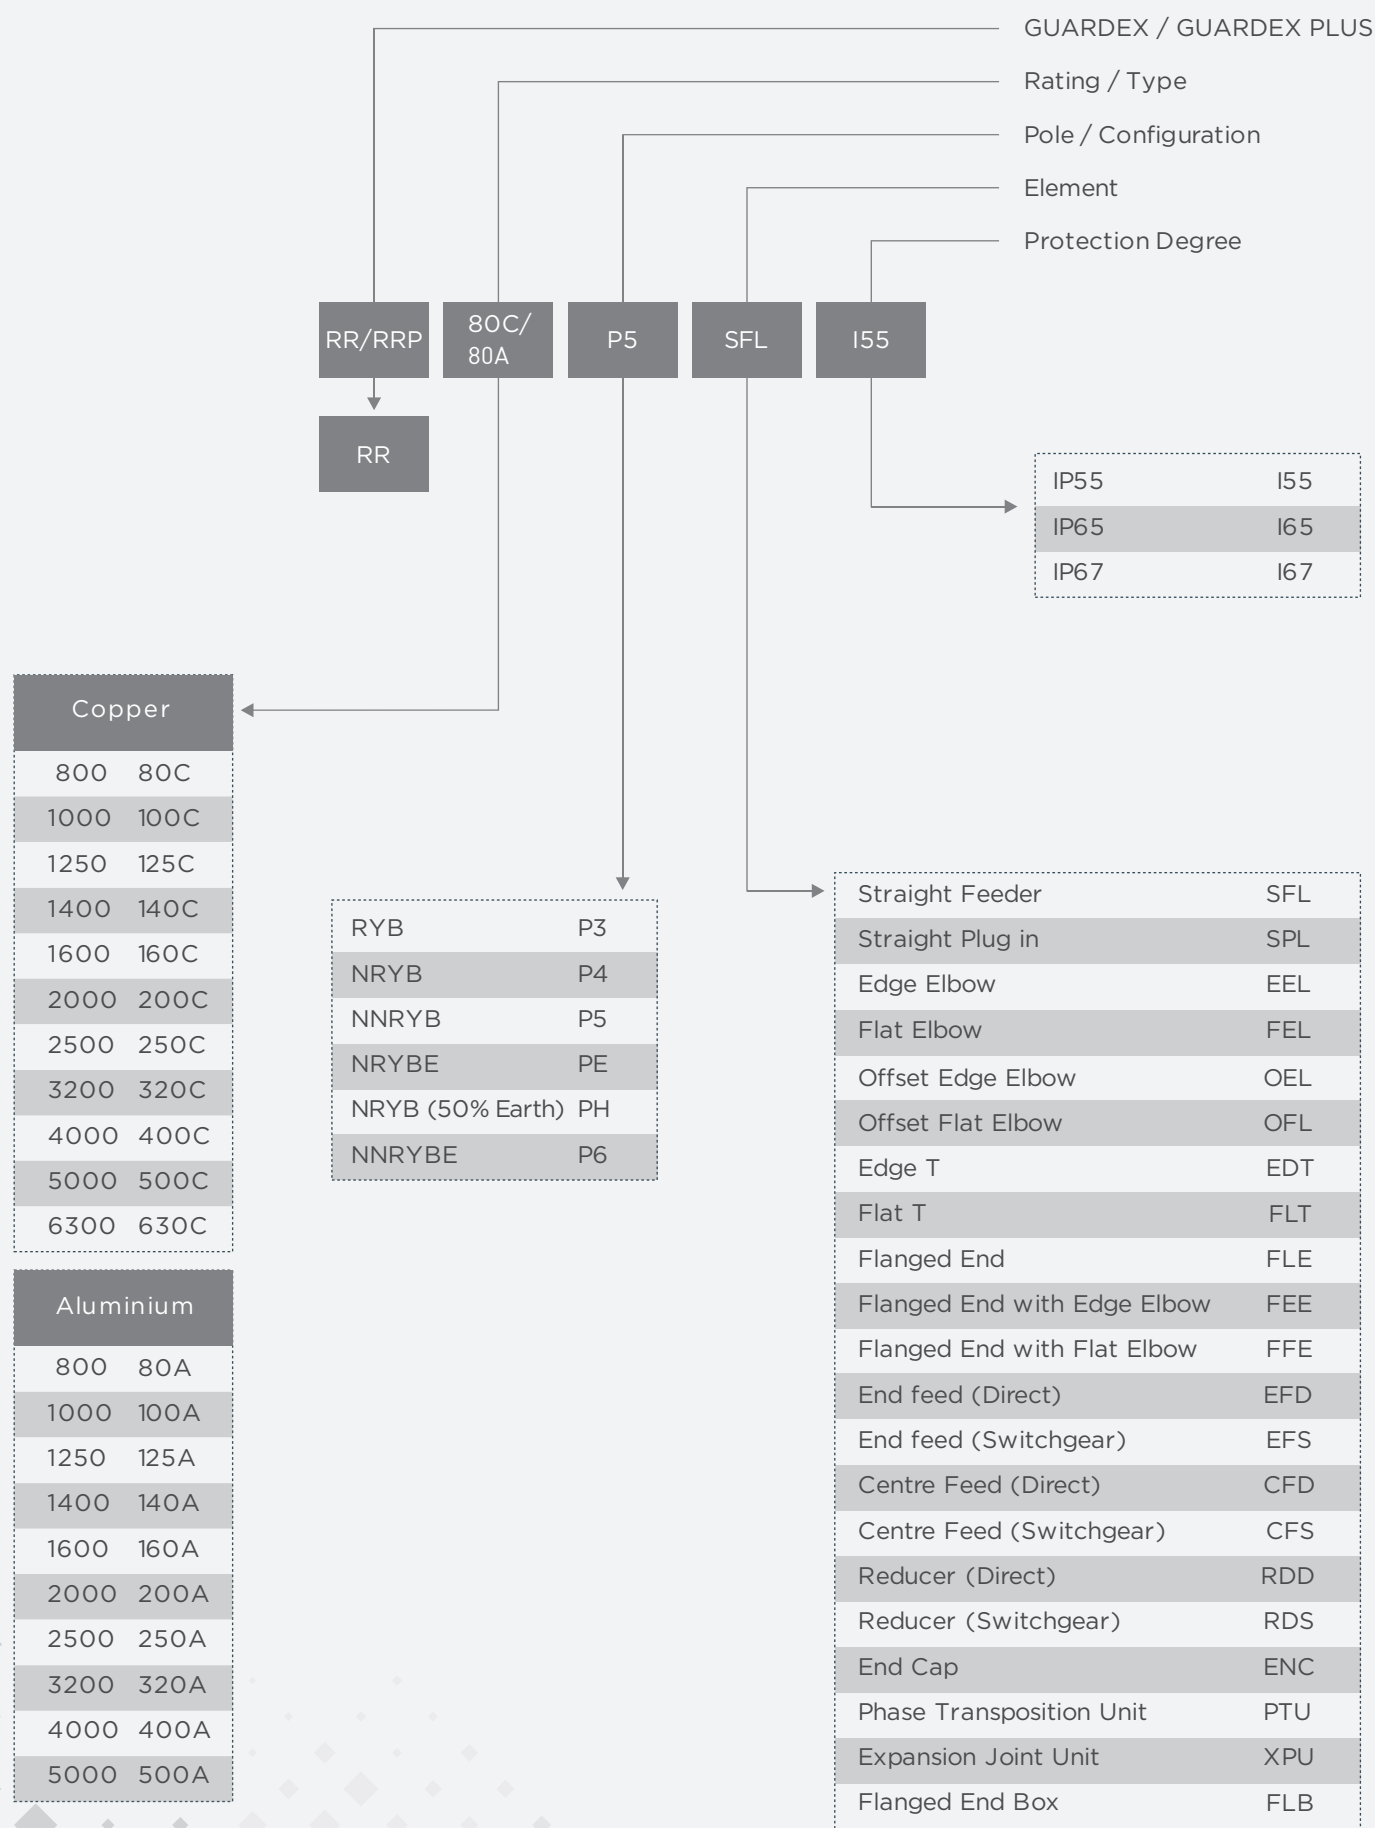

EDGEWISE ELBOWS

COPPER EDGEWISE ELBOWS DIMENSIONS (GUARDEX)

Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)		Standard Size (mm)		Maximum size (mm)	
		X	Y	X	Y	X	Y
800A	1 X 50 X 6	250	250	350	350	750	750
1000A	1 X 60 X 6	250	250	350	350	750	750
1250A	1 X 70 X 6	250	250	350	350	750	750
1400A	1 X 80 X 6	250	250	350	350	750	750
1400A	1 X 100 X 6	250	250	350	350	750	750
1600A	1 X 100 X 6	250	250	350	350	750	750
2000A	1 X 125 X 6	250	250	350	350	750	750
2000A	1 X 150 X 6	250	250	350	350	750	750
2500A	1 X 200 X 6	250	250	350	350	750	750
2500A	2 X 80 X 6	250	250	350	350	750	750
3200A	2 X 110 X 6	250	250	350	350	750	750
4000A	2 X 150 X 6	250	250	350	350	750	750
5000A	2X 200 X 6	250	250	350	350	750	750
6300A	3 X 150 X 6	250	250	350	350	850	850

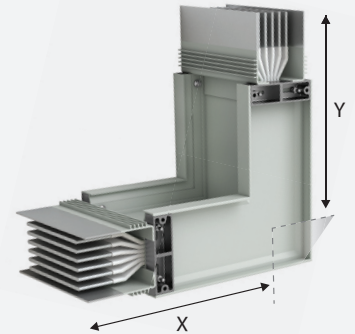


COPPER EDGEWISE ELBOWS DIMENSIONS (GUARDEX PLUS)

Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)		Standard Size (mm)		Maximum size (mm)	
		X	Y	X	Y	X	Y
800A	1 X 45(P) X 6	250	250	350	350	750	750
1000A	1 X 45 X 6	250	250	350	350	750	750
1250A	1 X 55 X 6	250	250	350	350	750	750
1600A	1 X 80 X 6	250	250	350	350	750	750
2000A	1 X 110 X 6	250	250	350	350	750	750
2500A	1 X 150 X 6	250	250	350	350	750	750
3200A	2 X 95 X 6	250	250	350	350	750	750
4000A	2 X 120 X 6	250	250	350	350	750	750
5000A	2 X 160 X 6	250	250	350	350	750	750

ALUMINIUM EDGEWISE ELBOWS DIMENSIONS

Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)		Standard Size (mm)		Maximum size (mm)	
		X	Y	X	Y	X	Y
800A	1 X 60 X 6	250	250	350	350	750	750
1000A	1 X 80 X 6	250	250	350	350	750	750
1250A	1 X 110 X 6	250	250	350	350	750	750
1600A	1 X 150 X 6	250	250	350	350	750	750
2000A	1 X 200 X 6	250	250	350	350	750	750
2500A	2 X 125 X 6	250	250	350	350	750	750
3200A	2 X 150 X 6	250	250	350	350	750	750
4000A	2 X 200 X 6	250	250	350	350	750	750
5000A	3 X 200 X 6	250	250	350	350	750	750

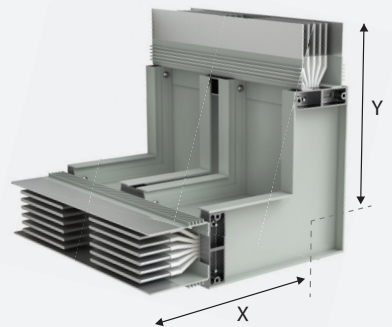


Note:- Special lengths can be made available according to the site conditions or the client requirements.

EDGEWISE OFFSETS

COPPER EDGEWISE OFFSETS DIMENSIONS (GUARDEX)

Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)		Standard Size (mm)		Maximum size (mm)	
		X	Y	X	Y	X	Y
800A	1 X 50 X 6	250	180	350	350	750	750
1000A	1 X 60 X 6	250	180	350	350	750	750
1250A	1 X 70 X 6	250	180	350	350	750	750
1400A	1 X 80 X 6	250	180	350	350	750	750
1400A	1 X 100 X 6	250	180	350	350	750	750
1600A	1 X 100 X 6	250	180	350	350	750	750
2000A	1 X 125 X 6	250	180	350	350	750	750
2000A	1 X 150 X 6	250	180	350	350	750	750
2500A	1 X 200 X 6	250	180	350	350	750	750
2500A	2 X 80 X 6	250	180	350	350	750	750
3200A	2 X 110 X 6	250	180	350	350	750	750
4000A	2 X 150 X 6	250	180	350	350	750	750
5000A	2X 200 X 6	250	180	350	350	750	750
6300A	3 X 150 X 6	250	180	350	350	850	850

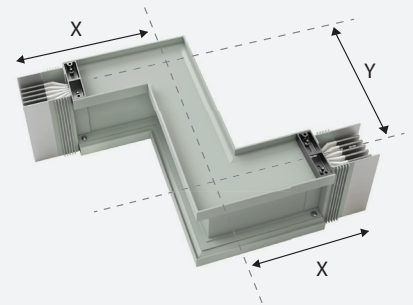


COPPER EDGEWISE OFFSETS DIMENSIONS (GUARDEX PLUS)

Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)		Standard Size (mm)		Maximum size (mm)	
		X	Y	X	Y	X	Y
800A	1 X 45(P) X 6	250	180	350	350	750	750
1000A	1 X 45 X 6	250	180	350	350	750	750
1250A	1 X 55 X 6	250	180	350	350	750	750
1600A	1 X 80 X 6	250	180	350	350	750	750
2000A	1 X 110 X 6	250	180	350	350	750	750
2500A	1 X 150 X 6	250	180	350	350	750	750
3200A	2 X 95 X 6	250	180	350	350	750	750
4000A	2 X 120 X 6	250	180	350	350	750	750
5000A	2 X 160 X 6	250	180	350	350	750	750

ALUMINIUM EDGEWISE OFFSETS DIMENSIONS

Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)		Standard Size (mm)		Maximum size (mm)	
		X	Y	X	Y	X	Y
800A	1 X 60 X 6	250	180	350	350	750	750
1000A	1 X 80 X 6	250	180	350	350	750	750
1250A	1 X 110 X 6	250	180	350	350	750	750
1600A	1 X 150 X 6	250	180	350	350	750	750
2000A	1 X 200 X 6	250	180	350	350	750	750
2500A	2 X 125 X 6	250	180	350	350	750	750
3200A	2 X 150 X 6	250	180	350	350	750	750
4000A	2 X 200 X 6	250	180	350	350	750	750
5000A	3 X 200 X 6	250	180	350	350	800	800

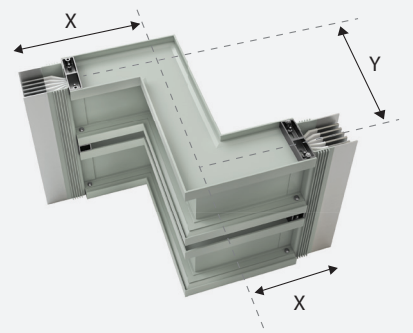

Note: Special length are available according to the site condition.

FLATWISE ELBOWS

COPPER FLATWISE ELBOW DIMENSIONS (GUARDEX)

Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)		Standard Size (mm)		Maximum size (mm)	
		X	Y	X	Y	X	Y
800A	1 X 50 X 6	275	275	350	350	750	750
1000A	1 X 60 X 6	300	300	350	350	750	750
1250A	1 X 70 X 6	300	300	350	350	750	750
1400A	1 X 80 X 6	300	300	350	350	750	750
1400A	1 X 100 X 6	300	300	350	350	750	750
1600A	1 X 100 X 6	300	300	350	350	750	750
2000A	1 X 125 X 6	325	325	350	350	750	750
2000A	1 X 150 X 6	325	325	350	350	750	750
2500A	1 X 200 X 6	350	350	350	350	750	750
2500A	2 X 80 X 6	375	375	500	500	750	750
3200A	2 X 110 X 6	425	425	500	500	750	750
4000A	2 X 150 X 6	450	450	500	500	750	750
5000A	2 X 200 X 6	500	500	500	500	750	750
6300A	3 X 150 X 6	575	575	600	600	750	750



COPPER FLATWISE ELBOW DIMENSIONS (GUARDEX PLUS)

Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)		Standard Size (mm)		Maximum size (mm)	
		X	Y	X	Y	X	Y
800A	1 X 45(P) X 6	275	275	350	350	750	750
1000A	1 X 45 X 6	275	275	350	350	750	750
1250A	1 X 55 X 6	275	275	350	350	750	750
1600A	1 X 80 X 6	300	300	350	350	750	750
2000A	1 X 110 X 6	325	325	350	350	750	750
2500A	1 X 150 X 6	325	325	350	350	750	750
3200A	2 X 95 X 6	400	400	500	500	750	750
4000A	2 X 120 X 6	425	425	500	500	750	750
5000A	2 X 160 X 6	475	475	500	500	750	750

ALUMINIUM FLATWISE ELBOW DIMENSIONS

Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)		Standard Size (mm)		Maximum size (mm)	
		X	Y	X	Y	X	Y
800A	1 X 60 X 6	300	300	350	350	750	750
1000A	1 X 80 X 6	300	300	350	350	750	750
1250A	1 X 110 X 6	325	325	350	350	750	750
1600A	1 X 150 X 6	325	325	350	350	750	750
2000A	1 X 200 X 6	350	350	350	350	750	750
2500A	2 X 125 X 6	425	425	500	500	750	750
3200A	2 X 150 X 6	450	450	500	500	750	750
4000A	2 X 200 X 6	500	500	500	500	750	750
5000A	3 X 200 X 6	650	650	700	700	750	750


Note: Special length are available according to the site condition.

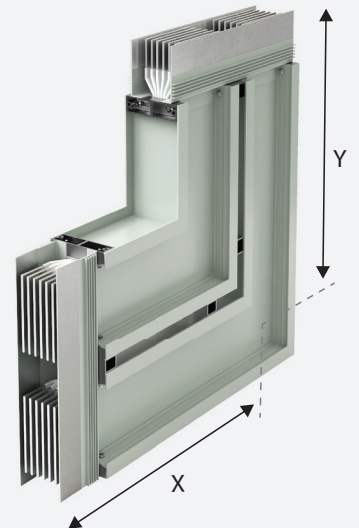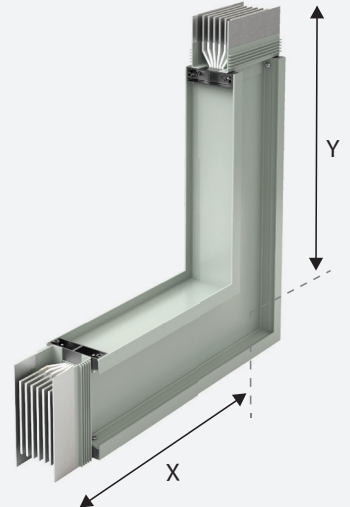

FLATWISE OFFSETS


COPPER FLATWISE OFFSETS DIMENSIONS (GUARDEX)

Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)		Standard Size (mm)		Maximum size (mm)	
		X	Y	X	Y	X	Y
800A	1 X 50 X 6	275	125	350	350	600	600
1000A	1 X 60 X 6	300	125	350	350	600	600
1250A	1 X 70 X 6	300	150	350	350	600	600
1400A	1 X 80 X 6	300	150	350	350	600	600
1400A	1 X 100 X 6	300	150	350	350	600	600
1600A	1 X 100 X 6	300	150	350	350	600	600
2000A	1 X 125 X 6	325	175	350	350	600	600
2000A	1 X 150 X 6	325	250	350	350	600	600
2500A	1 X 200 X 6	350	300	350	350	600	600
2500A	2 X 80 X 6	375	150	500	500	600	600
3200A	2 X 110 X 6	425	150	500	500	600	600
4000A	2 X 150 X 6	450	250	500	500	600	600
5000A	2X 200 X 6	500	300	500	500	600	600
6300A	3 X 150 X 6	575	250	700	700	850	850

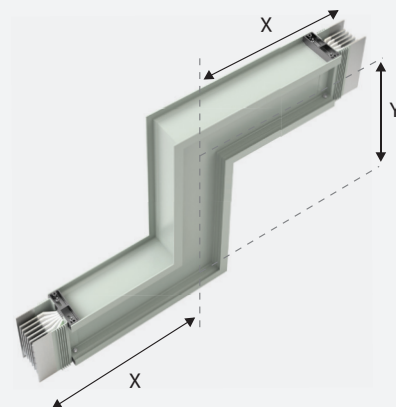

COPPER FLATWISE OFFSETS DIMENSIONS (GUARDEX PLUS)

Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)		Standard Size (mm)		Maximum size (mm)	
		X	Y	X	Y	X	Y
800A	1 X 45(P) X 6	275	125	350	350	600	600
1000A	1 X 45 X 6	275	125	350	350	600	600
1250A	1 X 55 X 6	275	125	350	350	600	600
1600A	1 X 80 X 6	300	150	350	350	600	600
2000A	1 X 110 X 6	325	150	350	350	600	600
2500A	1 X 150 X 6	325	250	350	350	600	600
3200A	2 X 95 X 6	400	150	500	500	600	600
4000A	2 X 120 X 6	425	175	500	500	600	600
5000A	2 X 160 X 6	475	250	500	500	600	600

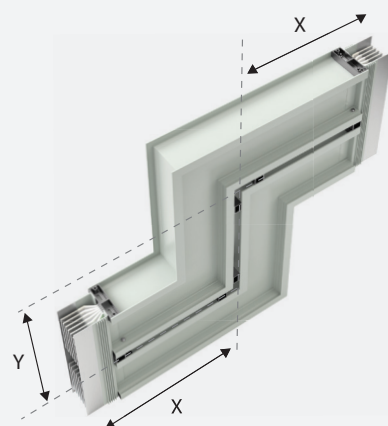

ALUMINIUM FLATWISE OFFSETS DIMENSIONS

Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)		Standard Size (mm)		Maximum size (mm)	
		X	Y	X	Y	X	Y
800A	1 X 60 X 6	300	125	350	350	600	600
1000A	1 X 80 X 6	300	150	350	350	600	600
1250A	1 X 110 X 6	325	150	350	350	600	600
1600A	1 X 150 X 6	325	250	350	350	600	600
2000A	1 X 200 X 6	350	300	350	350	600	600
2500A	2 X 125 X 6	425	175	500	500	600	600
3200A	2 X 150 X 6	450	250	500	500	600	600
4000A	2 X 200 X 6	500	300	500	500	600	600
5000A	3 X 200 X 6	650	300	700	700	800	800


Note: Special length are available according to the site condition.

COMBINATION ELBOW

Combination elbow provides freedom to design all possible layouts of a Busbar system. Special length are available according to the site condition.


COPPER COMBINATION ELBOW DIMENSIONS (GUARDEX)

Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)			Standard Size (mm)			Maximum size (mm)		
		X	Y	Z	X	Y	Z	X	Y	Z
800A	1 X 50 X 6	300	200	250	350	350	350	700	700	700
1000A	1 X 60 X 6	300	225	250	350	350	350	700	700	700
1250A	1 X 70 X 6	300	225	250	350	350	350	700	700	700
1400A	1 X 80 X 6	325	225	250	350	350	350	700	700	700
1400A	1 X 100 X 6	325	225	250	350	350	350	700	700	700
1600A	1 X 100 X 6	325	225	250	350	350	350	700	700	700
2000A	1 X 125 X 6	325	250	250	350	350	350	700	700	700
2000A	1 X 150 X 6	350	250	250	350	350	350	700	700	700
2500A	1 X 200 X 6	375	275	250	500	500	350	700	700	700
2500A	2 X 80 X 6	400	325	250	500	500	350	700	700	700
3200A	2 X 110 X 6	425	350	250	500	500	350	700	700	700
4000A	2 X 150 X 6	475	375	250	500	500	350	700	700	700
5000A	2 X 200 X 6	525	425	250	600	500	350	700	700	700
6300A	3 X 150 X 6	600	500	250	600	500	350	700	700	700

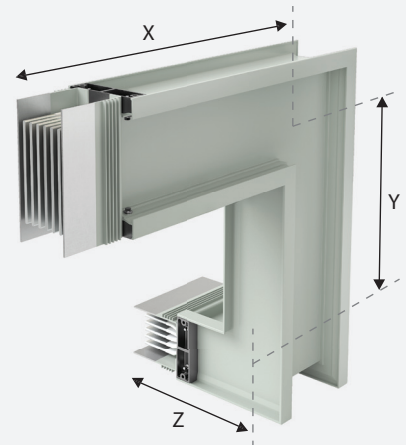

COPPER COMBINATION ELBOW DIMENSIONS (GUARDEX PLUS)

Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)			Standard Size (mm)			Maximum size (mm)		
		X	Y	Z	X	Y	Z	X	Y	Z
800A	1 X 45(P) X 6	300	200	250	350	350	350	700	700	700
1000A	1 X 45 X 6	300	200	250	350	350	350	700	700	700
1250A	1 X 55 X 6	300	225	250	350	350	350	700	700	700
1600A	1 X 80 X 6	325	225	250	350	350	350	700	700	700
2000A	1 X 110 X 6	325	250	250	350	350	350	700	700	700
2500A	1 X 150 X 6	350	250	250	350	350	350	700	700	700
3200A	2 X 95 X 6	425	325	250	500	500	350	700	700	700
4000A	2 X 120 X 6	450	350	250	500	500	350	700	700	700
5000A	2 X 160 X 6	500	400	250	500	500	350	700	700	700

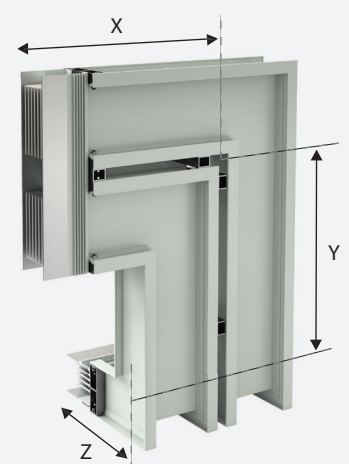

ALUMINIUM COMBINATION ELBOW DIMENSIONS

Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)			Standard Size (mm)			Maximum size (mm)		
		X	Y	Z	X	Y	Z	X	Y	Z
800A	1 X 60 X 6	300	125	250	350	350	350	700	700	700
1000A	1 X 80 X 6	300	150	250	350	350	350	700	700	700
1250A	1 X 110 X 6	325	150	250	350	350	350	700	700	700
1600A	1 X 150 X 6	325	250	250	350	350	350	700	700	700
2000A	1 X 200 X 6	350	300	250	350	350	350	700	700	700
2500A	2 X 125 X 6	425	175	250	500	500	350	700	700	700
3200A	2 X 150 X 6	450	250	250	500	500	350	700	700	700
4000A	2 X 200 X 6	500	300	250	500	500	350	700	700	700
5000A	3 X 200 X 6	650	300	250	700	700	350	700	700	700

Note: Special length are available according to the site condition.


FLATWISE TEE

COPPER FLATWISE TEE DIMENSIONS (GUARDEX)

Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)		Standard Size (mm)		Maximum size (mm)	
		X	Y	X	Y	X	Y
800A	1 X 50 X 6	550	275	750	350	1500	600
1000A	1 X 60 X 6	575	300	750	350	1500	600
1250A	1 X 70 X 6	575	300	750	350	1500	600
1400A	1 X 80 X 6	600	300	750	350	1500	600
1400A	1 X 100 X 6	600	300	750	350	1500	600
1600A	1 X 100 X 6	600	300	750	350	1500	600
2000A	1 X 125 X 6	625	325	750	350	1500	600
2000A	1 X 150 X 6	650	325	750	350	1500	600
2500A	1 X 200 X 6	700	350	750	350	1500	600
2500A	2 X 80 X 6	750	375	1000	500	1500	600
3200A	2 X 110 X 6	825	425	1000	500	1500	600
4000A	2 X 150 X 6	900	450	1000	500	1500	600
5000A	2X 200 X 6	1000	500	1000	500	1500	600
6300A	3 X 150 X 6	1150	575	1200	600	1500	600

COPPER FLATWISE TEE DIMENSIONS (GUARDEX PLUS)

Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)		Standard Size (mm)		Maximum size (mm)	
		X	Y	X	Y	X	Y
800A	1X 45(P) X 6	550	275	750	350	1500	600
1000A	1 X 45 X 6	550	275	750	350	1500	600
1250A	1 X 55 X 6	575	275	750	350	1500	600
1600A	1 X 80 X 6	600	300	750	350	1500	600
2000A	1 X 110 X 6	625	325	750	350	1500	600
2500A	1 X 150 X 6	650	325	750	350	1500	600
3200A	2 X 95 X 6	800	400	1000	1000	1500	600
4000A	2 X 120 X 6	850	425	1000	1000	1500	600
5000A	2 X 160 X 6	925	475	1000	1000	1500	600

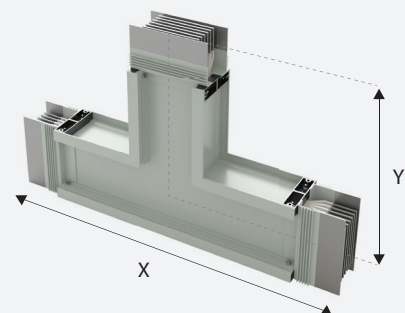


ALUMINIUM FLATWISE TEE DIMENSIONS

Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)		Standard Size (mm)		Maximum size (mm)	
		X	Y	X	Y	X	Y
800A	1 X 60 X 6	575	300	750	350	1500	600
1000A	1 X 80 X 6	600	300	750	350	1500	600
1250A	1 X 110 X 6	625	325	750	350	1500	600
1600A	1 X 150 X 6	650	325	750	350	1500	600
2000A	1 X 200 X 6	700	350	750	350	1500	600
2500A	2 X 125 X 6	850	425	1000	1000	1500	600
3200A	2 X 150 X 6	900	450	1000	1000	1500	600
4000A	2 X 200 X 6	1000	500	1000	1000	1500	600
5000A	3 X 200 X 6	1300	650	1300	1300	1500	600

EXPANSION UNITS

- Expansion unit shall allow (plus/minus) 50mm movement.
- The Expansion Unit is to pass through expanded sections of the building.
- The Expansion Unit is used to counteract irregularities in the building foundation caused by ground subsidence.

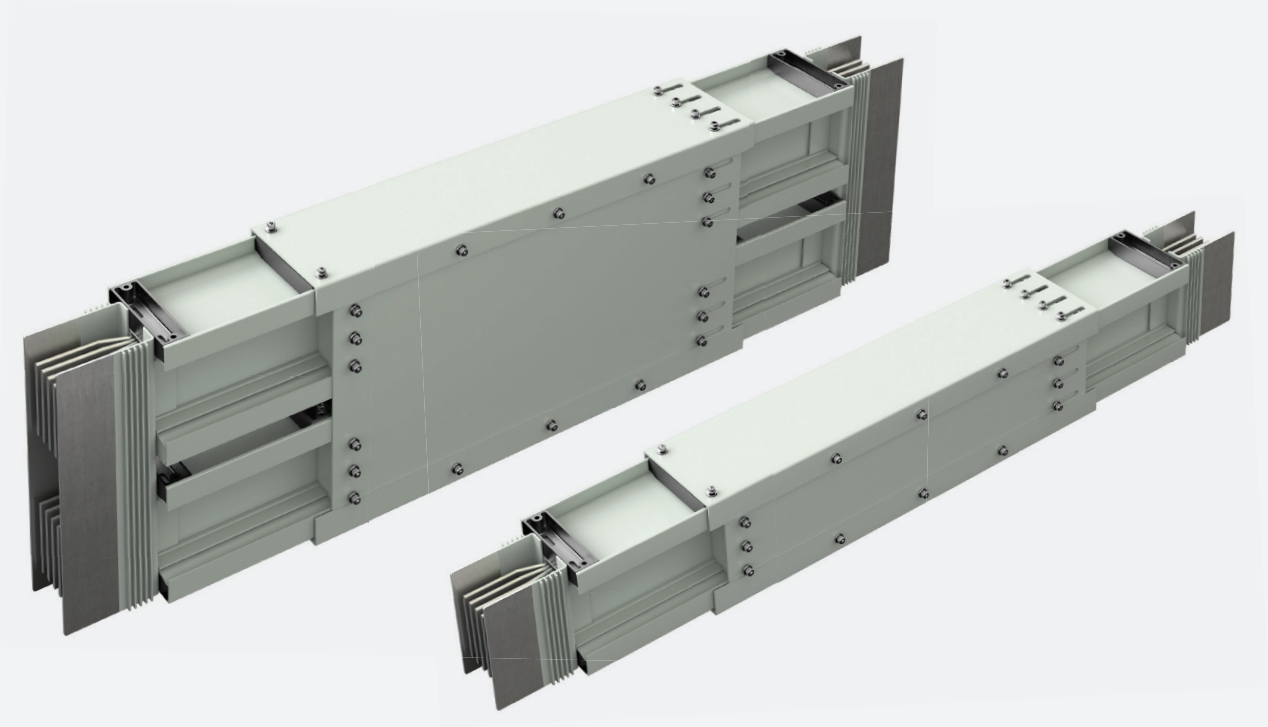


Expansion unit standard length (L) 1500mm.

FLANGES


COPPER FLANGES DIMENSIONS (GUARDEX)

Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)	Standard Size (mm)	Maximum size (mm)
		X	X	X
800A	1 X 50 X 6	230	300	850
1000A	1 X 60 X 6	230	300	850
1250A	1 X 70 X 6	230	300	850
1400A	1 X 80 X 6	230	300	850
1400A	1 X 100 X 6	230	300	850
1600A	1 X 100 X 6	230	300	850
2000A	1 X 125 X 6	230	300	850
2000A	1 X 150 X 6	230	300	850
2500A	1 X 200 X 6	230	300	850
2500A	2 X 80 X 6	230	300	850
3200A	2 X 110 X 6	230	300	850
4000A	2 X 150 X 6	230	300	850
5000A	2 X 200 X 6	230	300	850
6300A	3 X 150 X 6	230	300	850

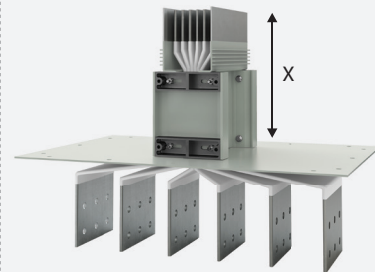


COPPER FLANGES DIMENSIONS (GUARDEX PLUS)

Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)	Standard Size (mm)	Maximum size (mm)
		X	X	X
800A	1 X 45(P) X 6	230	300	850
1000A	1 X 45 X 6	230	300	850
1250A	1 X 55 X 6	230	300	850
1600A	1 X 80 X 6	230	300	850
2000A	1 X 110 X 6	230	300	850
2500A	1 X 150 X 6	230	300	850
3200A	2 X 95 X 6	230	300	850
4000A	2 X 120 X 6	230	300	850
5000A	2 X 160 X 6	230	300	850

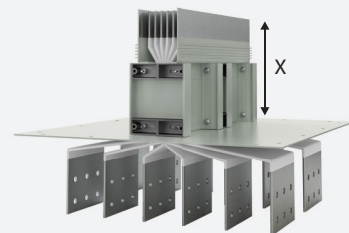

ALUMINIUM FLANGES DIMENSIONS


Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)	Standard Size (mm)	Maximum size (mm)
		X	X	X
800A	1 X 60 X 6	230	300	850
1000A	1 X 80 X 6	230	300	850
1250A	1 X 110 X 6	230	300	850
1600A	1 X 150 X 6	230	300	850
2000A	1 X 200 X 6	230	300	850
2500A	2 X 125 X 6	230	300	850
3200A	2 X 150 X 6	230	300	850
4000A	2 X 200 X 6	230	300	850
5000A	3 X 200 X 6	230	300	850

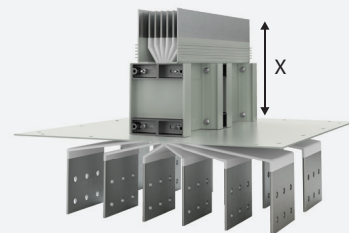

COMBINATION FLANGES


COPPER FLATWISE ELBOW FLANGE DIMENSIONS (GUARDEX)

Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)		Standard Size (mm)		Maximum size (mm)	
		X	Y	X	Y	X	Y
800A	1 X 50 X 6	275	175	350	350	700	700
1000A	1 X 60 X 6	300	175	350	350	700	700
1250A	1 X 70 X 6	300	175	350	350	700	700
1400A	1 X 80 X 6	300	175	350	350	700	700
1400A	1 X 100 X 6	300	175	350	350	700	700
1600A	1 X 100 X 6	300	175	350	350	700	700
2000A	1 X 125 X 6	325	175	350	350	700	700
2000A	1 X 150 X 6	325	200	350	350	700	700
2500A	1 X 200 X 6	350	225	350	350	700	700
2500A	2 X 80 X 6	375	250	500	500	700	700
3200A	2 X 110 X 6	425	275	500	500	700	700
4000A	2 X 150 X 6	450	325	500	500	700	700
5000A	2X 200 X 6	500	375	500	500	700	700
6300A	3 X 150 X 6	575	425	600	600	700	700

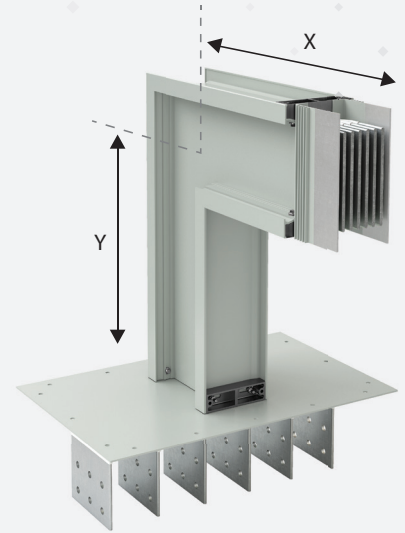


COPPER FLATWISE ELBOW FLANGE DIMENSIONS (GUARDEX PLUS)

Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)		Standard Size (mm)		Maximum size (mm)	
		X	Y	X	Y	X	Y
800A	1 X 45(P) X 6	275	175	350	350	700	700
1000A	1 X 45 X 6	275	175	350	350	700	700
1250A	1 X 55 X 6	275	175	350	350	700	700
1600A	1 X 80 X 6	300	175	350	350	700	700
2000A	1 X 110 X 6	325	175	350	350	700	700
2500A	1 X 150 X 6	325	200	350	350	700	700
3200A	2 X 95 X 6	400	250	500	500	700	700
4000A	2 X 120 X 6	425	275	500	500	700	700
5000A	2 X 160 X 6	475	325	500	500	700	700

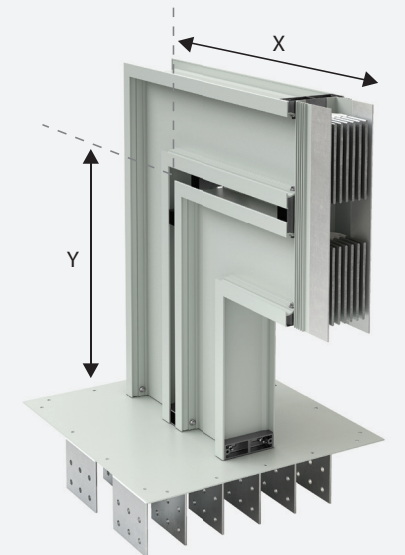

ALUMINIUM FLATWISE ELBOW FLANGE DIMENSIONS


Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)		Standard Size (mm)		Maximum size (mm)	
		X	Y	X	Y	X	Y
800A	1 X 60 X 6	300	175	350	350	700	700
1000A	1 X 80 X 6	300	175	350	350	700	700
1250A	1 X 110 X 6	325	175	350	350	700	700
1600A	1 X 150 X 6	325	200	350	350	700	700
2000A	1 X 200 X 6	350	225	350	350	700	700
2500A	2 X 125 X 6	425	300	500	500	700	700
3200A	2 X 150 X 6	450	300	500	500	700	700
4000A	2 X 200 X 6	500	350	500	500	700	700
5000A	3 X 200 X 6	650	500	700	700	700	700

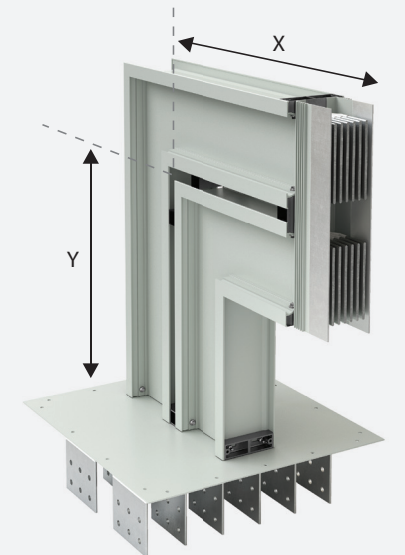

ELBOW FLANGES


COPPER EDGEWISE ELBOW FLANGE DIMENSIONS (GUARDEX)

Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)		Standard Size (mm)		Maximum size (mm)	
		X	Y	X	Y	X	Y
800A	1 X 50 X 6	200	250	350	350	700	700
1000A	1 X 60 X 6	200	250	350	350	700	700
1250A	1 X 70 X 6	200	250	350	350	700	700
1400A	1 X 80 X 6	200	250	350	350	700	700
1400A	1 X 100 X 6	200	250	350	350	700	700
1600A	1 X 100 X 6	200	250	350	350	700	700
2000A	1 X 125 X 6	200	250	350	350	700	700
2000A	1 X 150 X 6	200	250	350	350	700	700
2500A	1 X 200 X 6	200	250	350	350	700	700
2500A	2 X 80 X 6	200	250	350	350	700	700
3200A	2 X 110 X 6	200	250	350	350	700	700
4000A	2 X 150 X 6	200	250	350	350	700	700
5000A	2 X 200 X 6	200	250	350	350	700	700
6300A	3 X 150 X 6	200	250	350	350	700	700

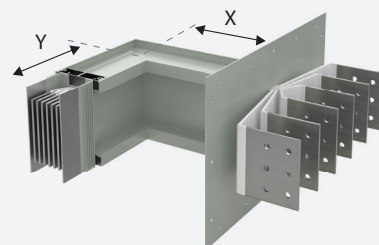

COPPER EDGEWISE ELBOW FLANGE DIMENSIONS (GUARDEX PLUS)



Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)		Standard Size (mm)		Maximum size (mm)	
		X	Y	X	Y	X	Y
800A	1 X 45(P) X 6	200	250	350	350	700	700
1000A	1 X 45 X 6	200	250	350	350	700	700
1250A	1 X 55 X 6	200	250	350	350	700	700
1600A	1 X 80 X 6	200	250	350	350	700	700
2000A	1 X 110 X 6	200	250	350	350	700	700
2500A	1 X 150 X 6	200	250	350	350	700	700
3200A	2 X 95 X 6	200	250	350	350	700	700
4000A	2 X 120 X 6	200	250	350	350	700	700
5000A	2 X 160 X 6	200	250	350	350	700	700

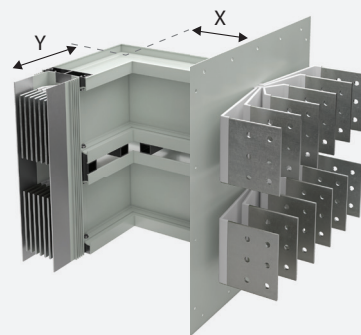

ALUMINIUM EDGEWISE ELBOW FLANGE DIMENSIONS

Busbar Rating (Amps)	Conductor Size in mm	Minimum Size (mm)		Standard Size (mm)		Maximum size (mm)	
		X	Y	X	Y	X	Y
800A	1 X 60 X 6	200	250	350	350	700	700
1000A	1 X 80 X 6	200	250	350	350	700	700
1250A	1 X 110 X 6	200	250	350	350	700	700
1600A	1 X 150 X 6	200	250	350	350	700	700
2000A	1 X 200 X 6	200	250	350	350	700	700
2500A	2 X 125 X 6	200	250	350	350	700	700
3200A	2 X 150 X 6	200	250	350	350	700	700
4000A	2 X 200 X 6	200	250	350	350	700	700
5000A	3 X 200 X 6	200	250	350	350	700	700


PHASE CROSSOVER UNIT

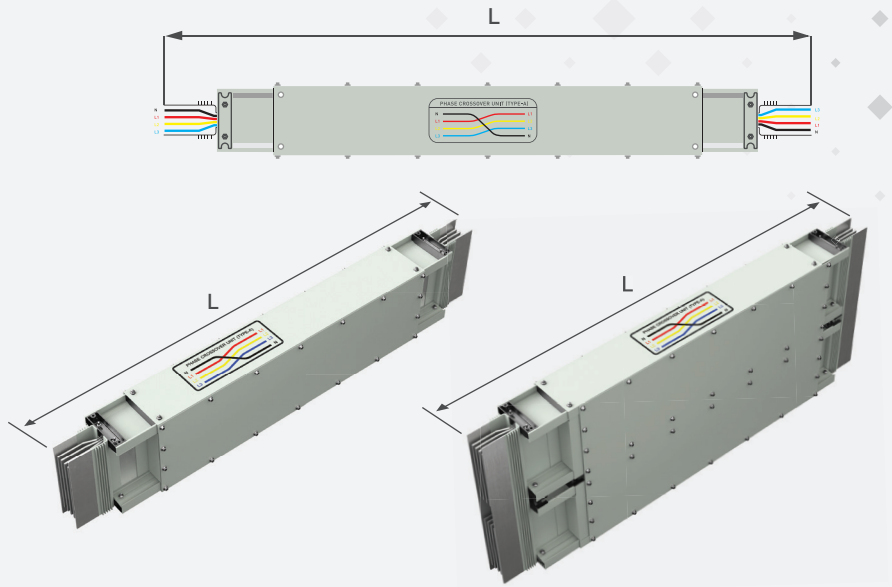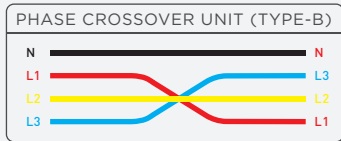

Phase-crossover unit standard length (L) 1500mm.

Phase-crossover unit to be used when the application requires a phase rotation in the power supply. Phase-crossover unit are used to change the relative position of the phase conductor in order to balance the inductive reactance or to transpose the phase.

WALL / FLOOR FLANGE

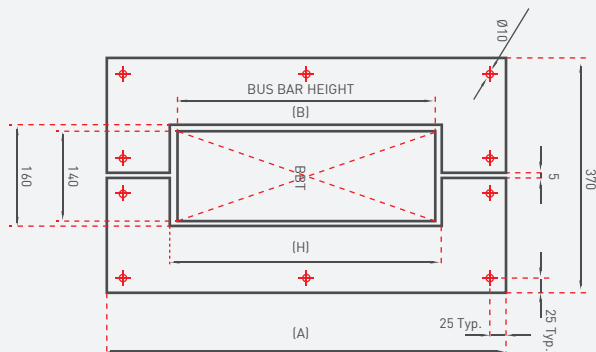

SYSTEM COMPONENTS

Busbar Rating (Amps)	WALL FLANGE / FLOOR FLANGE DIMENSIONS		
	Size (mm)	Size (mm)	Size (mm)
	B	H	A
800A	120	140	340
1000A	140	160	360
1250A	170	190	390
1600A	210	230	430
2000A	260	280	480
2500A	400	420	620
3200A	450	470	670
4000A	550	570	770
5000A	840	860	1060

REDUCER UNIT

SYSTEM COMPONENTS




Reducers are used to decrease the current-carrying capacity of busducts in the same route. Reducers can be used in vertical as well as horizontal power

COPPER AND ALUMINIUM REDUCERS DIMENSIONS

	Busbar Rating (Amps)	Size (mm) L
Standard	1000A to 800A	1000
Based on requirement	-	-

	Busbar Rating (Amps)	Size (mm) L
Standard	1250A to 800A	1000
Based on requirement	-	-

	Busbar Rating (Amps)	Size (mm) L
Standard	1600A to 1250A	1000
Based on requirement	1600A to 800A	1000

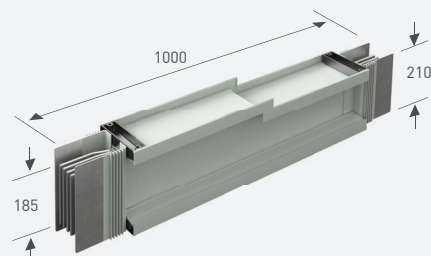
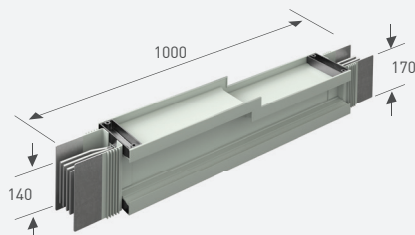
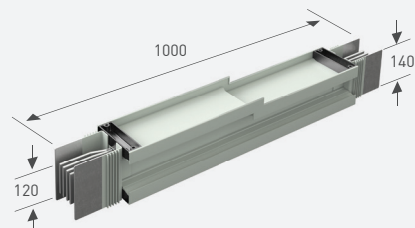


COPPER REDUCERS DIMENSIONS & ALUMINIUM REDUCERS DIMENSIONS

	Busbar Rating (Amps)	Size (mm) L
Standard	2000A to 1600A	1000
Based on requirement	-	-


	Busbar Rating (Amps)	Size (mm) L
Standard	3200A to 2500A	1000
Based on requirement	3200A to 4000A	1000

	Busbar Rating (Amps)	Size (mm) L
Standard	4000A to 3200A	1000
Based on requirement	-	-

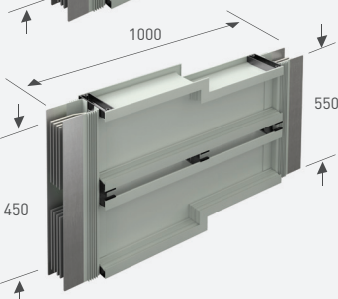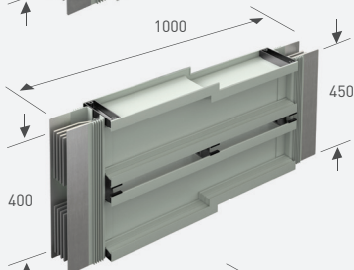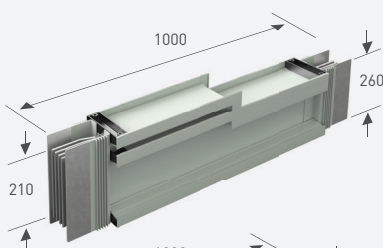

TAP - OFF BOXES

- Tap-off boxes are used to draw upto 800Amps (plug-in type) & 1000A - 1200A (inline) power from a busbar.
- Positioning of Tap off location can be made as per site requirments.

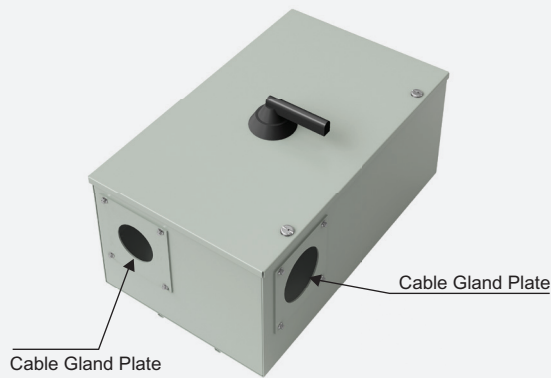

CABLE FEED UNITS

- Cable feed units are used to connect cable from one end of the bustrunking.
- Undrilled gland plate is provided at the bottom for multiple cable entry.




CENTER FEED UNITS

- Center feed units are used to connect cable from the middle of the bustrunking run.




END CAP

- End Cap is used to terminate and protect the Busbar run and can be removed from Busbar run when future expansion of the Busbar route required.

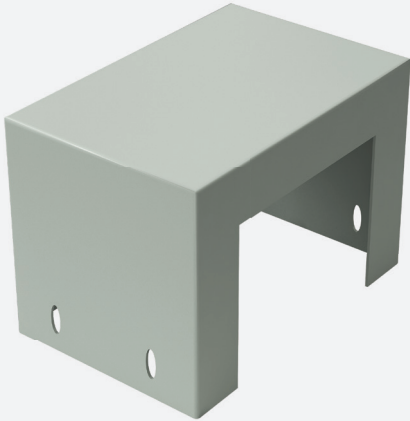

SPRING HANGER

- Spring Hanger is used to sustain Busbar Trunking Load and to allow expansion of the Busbar.

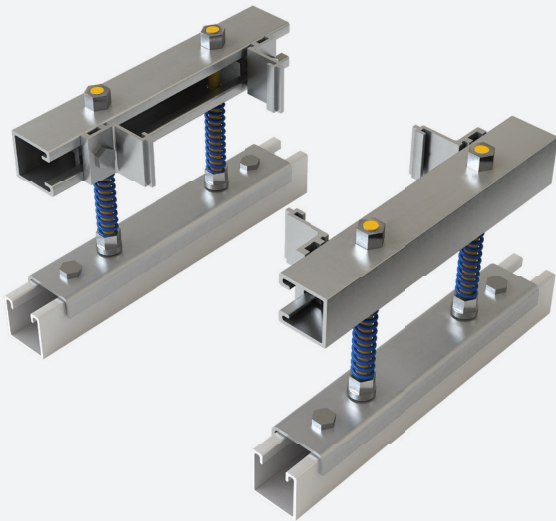

THE RIGHT PRODUCT AT THE RIGHT PLACE

HOSPITALS



Guardex by RR Busduct is a reliable and efficient electrical distribution system. It is a safe and robust power distribution system with high efficiency, low losses and high mechanical strength.

HOTELS/ HOSPITALITY



Guardex by RR Busduct offers the most comprehensive system to meet the requirements of a global market. Our Systems are suitable for 3 Phase 3 Wire, 3 Phase 4 Wire, 3 Phase 5 Wire and direct current distribution. Current ratings offered are from 800A to 6300A. Rated operational voltage upto 1000 V, IP degree upto IP67 and frequency 50/60Hz.

LARGE PLANTS/FACTORIES



Guardex by RR Busduct offers one of the lightest available sandwich products. The extruded aluminum housing offers a low magnetic system with low hysteresis losses and better efficiency.

SKYSCRAPPERS/TALL BUILDINGS



Guardex by RR Busduct is an obvious choice for various applications including commercial, industrial utilities, wind power, horizontal and vertical power distribution applications.

PRODUCT CERTIFICATION - GUARDEX PLUS

intertek
Test Quality Assured

ASTA TESTIFICATE

VERIFICATION OF TEST

Project No: G1043235ALC5006 **Certificate No:** ASTA-TLC-000364

Applicant: RRB Busbody Power Distribution Equipment Manufacturing Ltd., Plot No. 597
450K, Warehouse No. 4, Near Pepsi Bottlers, DUBI, Dubai, U.A.E.

Apparatus: BODU, TPNHE, 1000V/1000/BKV (UL44)450K, 50/GHzm, single-stage tubular
transforming system, with class F epoxy coated (in painted colour) busbars (profiled)
with outer layer polyester wrapped in an aluminium enamel comprising of
two flanged ends, two straight lengths and three joint sections.

Manufacturer
By: RRB Busbody Power Distribution Equipment Manufacturing Ltd., Plot No. 597
450K, Warehouse No. 4, Near Pepsi Bottlers, DUBI, Dubai, U.A.E.

Test Report No: 01006336-1

Designation: RRBPCBGRS/HUES / GUARDELS PLUS

The apparatus which is representative of the designation, supplied drawings and photographs has been evaluated in accordance with:

IEC (4349-6 : Edition 1) 2012-05-05 Clauses 10.2, 10.3, 10.4, 10.5, 10.9, 10.10, 10.11, 10.12 and Annex BB

Verifications with reference to the listed tests in Annex B of IEC 4349-6 : Edition 1 2012-05

1: Strength of material and parts	6.7/7b: Non verification by testing required
2: Degree of protection of enclosures	9: Dielectric properties
3: Clearances	10: Temperature rise limits
4: Creepage distances	11: Short circuit withstand strength
5: Protection against electric shock and strength of protective circuits	12: Electromagnetic compatibility (EMC)

Annex BB - Phase conductor characteristics

The results are shown on the records of tests attached herewith. The values obtained and the general performance is considered in comply with the above Standards and to justify the ratings assigned by the manufacturer as stated on the reverse page(s) of this Certificate. This Certificate applies only to the apparatus tested. Responsibility for conformity of any other apparatus being the same or other designations rests with the Manufacturer.

010

Certification
Engineer
Certification
Officer

23rd December 2020

Date

Intertek Testing Services Asia Pacific Pte Ltd. (Intertek Asia) is a wholly owned subsidiary of Intertek Group Inc. (Intertek), a public company registered in the United States of America. Intertek Asia is authorized to perform testing services under license from Intertek. Intertek is a global leader in product testing, inspection, and certification services. Intertek's services are used by manufacturers and service providers around the world to improve their products and processes, reduce risk, and ensure compliance with regulatory requirements. Intertek's commitment to quality and excellence is reflected in its ISO 9001 certification and its membership in various industry associations.



intertek
Total Quality Assurance

ASTA TYPE CERTIFICATE

VERIFICATION OF TEST

Project No: GR14343253/LCSU01 **Certificate No:** ASTA-Type-000339

Applicant: RIB Global Power Distribution Equipment Manufacturing LLC, Plot No. 597
4904, Warehouse No. 4, Near Pepsi Bottlers, DIP 2, Dubai, U.A.E.

Apparatus: 1000A, 1THNH, 1000V/1000/BV ($\Delta/\Delta/\Delta/\Delta$) 50Hz x 950A @ 60Hz,
single-stack busbar breaking system, with 1 spray coated on plated copper busbars with outer layer polyester wrapped in a aluminium edging consisting of two flanged ends, two straight lengths and three joint sections.

Manufacturer By: RIB Global Power Distribution Equipment Manufacturing LLC, Plot No. 597
4904, Warehouse No. 4, Near Pepsi Bottlers, DIP 2, Dubai, U.A.E.

Test Report No: RPP010039-2

Designation: RRP0100CHGFLUS / GUARDED PLUS

The apparatus which is representative of the designation, supplied drawings and photographs has been evaluated in accordance with:

IEC (1439-4 : Edition 2) 1000V-1000V-50 Hz Classes 10, 10.3, 10.4, 10.5, 10.9, 10.10, 10.11, 10.12 and Annex BB

Verifications with reference to the tables listed in Annex A of IEC 1439-4 : Edition 2 1000V-1000V-50 Hz

1:	Strength of material and parts	6/7/8:	No verification by testing required
2:	Degree of protection of enclosures	9:	Electricity properties
3:	Clearances	10:	Temperature rise limits
4:	Creepage of distances	11:	Short circuit withstand strength
5:	Protection against electric shock and integrity of protective circuits	12:	Electromagnetic compatibility (EMC)
Annex BB	Pneumatically conductor characteristics		

The results are shown in the record of tests attached herewith. The values obtained and the general performance is considered to comply with the above Standard(s) and to justify the ratings assigned by the manufacturer as stated on the rating plate(s) of this Certificate. This Certificate applies only to the apparatus tested. Responsibility for conformity of any other apparatus having the same or other designations rests with the Manufacturer.



010



24th December 2020

Engineer
Engineer
Certification
Officer

Date

For more information please visit our website at www.intertek.com. Intertek is a leading provider of product certification services, offering a wide range of standards-based testing and inspection services. We are committed to providing our clients with the highest quality of service and ensuring compliance with all applicable regulatory requirements.



Intertek
Total Quality Results

ASTA TYPE CERTIFICATE

VERIFICATION OF TEST

Project No: R104332534/C5002

Applicant: GIBB INDUSTRIES Power Equipment Manufacturing LLC, Plot No. 597 4904, Warehouse No. 4, Near Pepsi Bottlers, OIP 3, Dubai, U.A.E.

Apparatus: 1250A, 1794H, 1000V/1000V/8BV (U₀/U₁/U₂), 50Hz (U₀ = 1187.5A @ 60Hz), single-stack busbar breaking system, with class I epoxy coated tin plated copper busbars; with outer layer partially wrapped in a aluminium electrode comprising of two flanged ends, two straight lengths and three joint sections.

Manufacturer By: RIB Busbar Power Distribution Equipment Manufacturing LLC, Plot no. 597 4904, Warehouse No. 4, Near Pepsi Bottlers, OIP 3, Dubai, U.A.E.

Test Report No: RRP120301-03

Designation: RRP1203CPLG165 / GUARDER PLUS

Certificate No: ASTA-TYPE-000340

The apparatus which is representative of the designation, supplied drawings and photographs has been evaluated in accordance with:

IEC 61439-6: Edition 1 2012-05 Clauses 10.2, 10.3, 10.4, 10.5, 10.9, 10.10, 10.11, 10.12 and Annex B8

We conform, with reference to the tests listed in Annex B of IEC 61439-6, Edition 1 2012-05: 1. Strength of material and parts 2. Degree of protection of enclosures 3. Clearances 4. Creepage distances 5. Protection against electric shock and integrity of protective circuits	6.7/7b: No verification by testing required 9: Dielectric properties 10: Temperature rise limits 11: Short circuit withstand strength 12: Electromagnetic compatibility (EMC)
---	--

Annex B8: Phase conductor characteristics

The results are shown in the record of tests attached herewith. The values obtained and the general performance is considered to comply with the above Standard(s) and to justify the ratings assigned by the manufacturer as stated on the ratings page(s) of this Certificate. This Certificate and its annexes are issued for the apparatus tested. Responsibility for conformity of any apparatus having the same or other designations rests with the Manufacturer.



010



24th December 2020

Certification
Officer

Certification
Officer

Date

 Test Quality Assured											
ASTA TYPE CERTIFICATE VERIFICATION OF TEST											
Project No:	G10433253/LAC5003 Certificate No: ASTA-TCF-000341										
Applicant:	RR Budut Power Distribution Engineering Manufacturing LLC, Plot No. 597 450C, Warehouse No. 4, Near Pepsi Bottlers, Dubai 2, Dubai, U.A.E.										
Apparatus:	1400A, 1700H, 1000V/1000V/BV ($U_{L1}/U_{L2}/U_{L3}$, 50Hz ($U_n = 1520A \pm 1520A \pm 60Hz$), single-stack busbar /trunking system, with class I epoxy coated tin plated copper busbars of outer layer polymer wrapped in a aluminum extrusion comprising of two flanged ends, two straight lengths and three joint sections.										
Manufacturer	RR Budut Power Distribution Engineering Manufacturing LLC, Plot No. 597 450C, Warehouse No. 4, Near Pepsi Bottlers, Dubai 2, Dubai, U.A.E.										
Test Report No:	RRP000336-4										
Designation:	RRP000336/VS / GUARDED PLUS										
The apparatus which is representative of the designation, supplied drawings and photographs has been evaluated in accordance with: IEC (4349-6: Edition 1) 1000V/1000V/VS Clauses 10.2, 10.3, 10.4, 10.5, 10.9, 10.10, 10.11, 10.12 and Annex BS Verifications with reference to the tests listed in Annex D of IEC 4349-6: Edition 1 2012-03 <table border="0"><tr><td>1. Strength of material and parts</td><td>6.7/7B: No verification by testing required</td></tr><tr><td>2. Degree of protection of enclosures</td><td>9: Dielectric properties</td></tr><tr><td>3. Clearances</td><td>10: Temperature rise limits</td></tr><tr><td>4. Creepage distances</td><td>11: Short circuit withstand strength</td></tr><tr><td>5. Protection against electric shock and strength of protective circuits</td><td>12: Electromagnetic compatibility (EMC)</td></tr></table> Annex BS: These conductor characteristics The results are shown on the ratings of tests attached herewith. The values obtained and the general performance is considered to comply with the above Standards and to justify the ratings assigned by the manufacturer as stated on the reverse page of this Certificate. This Certificate applies only to the apparatus tested. Responsibility for the safety of the apparatus having the same or other designations rests with the Manufacturer.  n/a  34th December 2020 Certification Engineer Certification Officer Date		1. Strength of material and parts	6.7/7B: No verification by testing required	2. Degree of protection of enclosures	9: Dielectric properties	3. Clearances	10: Temperature rise limits	4. Creepage distances	11: Short circuit withstand strength	5. Protection against electric shock and strength of protective circuits	12: Electromagnetic compatibility (EMC)
1. Strength of material and parts	6.7/7B: No verification by testing required										
2. Degree of protection of enclosures	9: Dielectric properties										
3. Clearances	10: Temperature rise limits										
4. Creepage distances	11: Short circuit withstand strength										
5. Protection against electric shock and strength of protective circuits	12: Electromagnetic compatibility (EMC)										



Test Quality Assured

ASTA TYPE CERTIFICATE

VERIFICATION OF TEST

Project No: GI043253ALCS004

Applicant: RR BUDIST Power Distribution Equipment Manufacturing LLC, Plot No. 597 4904, Warehouse No. 4, Near Pepsi Bottlers, DIP 2, Dubai, U.A.E.

Apparatus: 2000A, 7THH, 1000V/1000V/BV (1000V/1000V, 50Hz + 1000A @ 60Hz), single-stack busbar trunking system, with class I epoxy coated on plated copper busbars with outer layer polyester wrapped in a aluminium enclosure comprising of two flanged ends, two straight lengths and three joint sections.

Manufacturer By: RR BUDIST Power Distribution Equipment Manufacturing LLC, Plot No. 597 4904, Warehouse No. 4, Near Pepsi Bottlers, DIP 2, Dubai, U.A.E.

Test Report No: 10000336-5

Designation: RRP200C2MG5FV / GUAEDEX PLUS

Certificate No: ASTA-TCF-000342

The apparatus which is representative of the designation, supplied drawings and photographs have been evaluated in accordance with:

IEC (14349 - 4: Edition 1) 2002-05 Clauses 10.2, 10.3, 10.4, 10.5, 10.9, 10.10, 10.11, 10.12 and Annex B

Verifications with reference to the tests listed in Annex B of IEC 44349 - 4: Edition 1 2002-05

1. Strength of material and parts	6/7/8:	No verification by testing required
2. Degree of protection of enclosures	9:	Dielectric properties
3. Clearances	10:	Temperature rise limits
4. Creepage distances	11:	Short circuit withstand strength
5. Protection against electric shock and integrity of protective circuits	12:	Electromagnetic compatibility (EMC)

Annex B8 : Phase conductor characteristics

The results are shown on the tests attached herewith. The values obtained and the general performance is considered to comply with the above Standard(s) and to justify the ratings assigned by the manufacturer as stated on the records page(s) of this Certificate. This Certificate applies only to the apparatus tested. Responsibility for conformity of any apparatus having the same or other designations rests with the Manufacturer.



010



5th January 2021

Certification
Engineer

Certification
Officer

Date

intertek
Total Quality Assurance

ASTA TYPE CERTIFICATE

VERIFICATION OF TEST

Project No: RRB25C03134-C5005 **Certificate No:** ASTA-TYPE-000343

Applicant: IRB Budget Power Distribution Equipment Manufacturing LLC, Plot no. 597
4904, Warehouse No. 4, Near Pepsi Bottlers, DIP 3, Dubai, U.A.E.

Apparatus: ZSD04, TP4HE, 1000V/1000V(VV (U_L/U_N)), 50Hz I_{IN} = 237RA @ 60kHz,
single-stack busbar trunking system, with class F epoxy coated inner winding
copper busbars; with outer layer polyester wrapped in a aluminium enclosure
comprising of two flanged ends, two straight lengths and three point sections.

Manufacturer By: IRB Budget Power Distribution Equipment Manufacturing LLC, Plot no. 597
4904, Warehouse No. 4, Near Pepsi Bottlers, DIP 3, Dubai, U.A.E.

Test Report No: 101003036-6

Designation: RRP25C03GULMS / GUARDED PLUS

The apparatus which is representative of the designation, supplied drawings and photographs has been examined in accordance with:

IEC 61439-6 : Edition 1 2012-05 Clauses 10.2, 10.3, 10.4, 10.5, 10.9, 10.10, 10.11, 10.12 and Annexes

Verifications with reference to the parts listed in Annex 5 of IEC 61439-6 Edition 1 2012-05

1.	Strength of material and tests	6/7/8:	No verification by testing required
2.	Degree of protection of enclosures	9:	Dielectric properties
3.	Clearances	10:	Temperature rise limits
4.	Crawpage distances	11:	Short circuit withstand strength
5.	Protection against electric shock and integrity of protective circuits	12:	Electromagnetic compatibility (EMC)

Annex Bb: Phase conductor characteristics

The results are shown in the record of tests attached herewith. The values obtained and the general performance is considered to comply with the above Standard(s) and to justify the ratings assigned by the manufacturer as stated on the ratings page(s) of this Certificate. This Certificate will be valid to the apparatus tested. Responsibility for conformity of any apparatus having the same or other designations rests with the Manufacturer.

010

[Signature]

5th January 2020

Certification Engineer
Certification Officer

Date

Document ID: TQA-INT-001
Version: 1.0

ASTA TYPE CERTIFICATE

VERIFICATION OF TEST

Project No: G10343253ALCS007 **Certificate No:** ASTA-TC-000636

Applicant: RRB Power Distribution Equipment Manufacturing LLC, Plot No. 597
490A, Warehouse No. 4, Near Pepsi Bottlers, DIP 2, Dubai, U.A.E.

Apparatus: 320DA, 320NH, 320OV/320OV/BBV (64/64/64), 50RZ ($\mu = 304DA$ @ 60Hz),
double-stacked busbar trucking system, with class F epoxy coated on plated
copper busbars with outer layer polymer wrapped in an aluminium edson
comprising of two flanged ends, two straight lengths and three joint sections.

Manufacturer: RRB Power Distribution Equipment Manufacturing LLC, Plot No. 597
490A, Warehouse No. 4, Near Pepsi Bottlers, DIP 2, Dubai, U.A.E.

By:

Test Report No: 01002336-7

Designation: RRP320CPS/BBV / GUARDEX PLUS

The apparatus which is representative of the designation, supplied drawings and photographs has been
evaluated in accordance with:

**IEC 61439-4 Edition 1: 2012/05-05 Clauses 10.2, 10.3, 10.4, 10.5, 10.6, 10.9, 10.10, 10.11, 10.12 and
Annex BB**

Verifications with reference to the tests listed in Annex D of IEC 61439-4 Edition 1: 2012-05

1: Strength of material and parts	6.7/7B: No verification by testing required
2: Degree of protection of enclosures	9: Dielectric properties by testing required
3: Clearances	10: Temperature rise limits
4: Creepage distances	11: Short circuit withstand strength
5: Protection against electric shock and strength of protective circuits	12: Electromagnetic compatibility (EMC)

Annex BB: Phase conductor characteristics

The results are shown in the record of tests attached herewith. The values obtained and the general
performance is considered to comply with the above standards and to justify the ratings assigned by the
manufacturer as stated on the drawings page(s) of this Certificate. This Certificate applies only to the
apparatus tested. Responsibility for conformity of any equipment having the same or other designations
rests with the Manufacturer.



UKAS
CERTIFICATION



6th January 2021

**Certification
Engineer**

**Certification
Officer**

Date

010



Intertek
Total Quality Assurance

ASTA TYPE CERTIFICATE

VERIFICATION OF TEST

Project No: G10433253ALCS008 **Certificate No:** ASTA-TCF-000637

Applicant: RRB Saudi Power Distribution Equipment Manufacturing LLC, Plot No. 597
4500A, Warehouse No. 4, Near Pepsi Bottlers, DIP 2, Dubai, U.A.E.

Apparatus: 4000A, 7THNE, 1000V/1000V/BV (U/Ls/400V), 50Hz (I_{sc} = 3800A @ 60Hz),
double-stack nuclear trucking system, with class 1 epoxy coated on plated
copper busbars with outer layer polyether wrapped in an aluminium electrode
comprising of two flanged ends, two straight lengths and three joint sections.

Manufacturer: RRB Saudi Power Distribution Equipment Manufacturing LLC, Plot No. 597
4500A, Warehouse No. 4, Near Pepsi Bottlers, DIP 2, Dubai, U.A.E.

Test Report No: RRP00039-8

Designation: RRP00039-8V / GUAEDEX PLUS

The apparatus which is representative of the designation, supplied drawings and photographs has been examined in accordance with:

IEC 61439-4: Edition 1: 2012-05 Clauses 10.2, 10.3, 10.4, 10.5, 10.9, 10.10, 10.11, 10.12 and Annex BB

Verifications with reference to the tests listed in Annex D of IEC 61439-4: Edition 1: 2012-05	
1/ Strength of material and parts	4/7/8: No verification by testing required
2/ Degree of protection of enclosures	9/ Dielectric properties
3/ Clearances	10/ Temperature rise limits
4/ Creepage distances	11/ Short circuit withstand strength
5/ Protection against electric shock and integrity of protective circuits	12/ Electromagnetic compatibility (EMC)

Annex BB: Power conductor characteristics

The results are shown in the record of tests attached herewith. The values obtained and the general performance is considered to comply with the above Standard(s) and to satisfy the ratings assigned by the manufacturer as stated on the ratings page(s) of this Certificate. This Certificate applies only to the apparatus tested. Responsibility for conformity of any apparatus having the same or other designations rests with the Manufacturer.



UKAS
CALIBRATION

010



01 Jun 2011

Certification
Engineer

Certification
Officer

Date

intertek
Total Quality Assurance

ASTA TYPE CERTIFICATE

VERIFICATION OF TEST

Project No: G10433234/C5009 **Certificate No:** ASTA-TYPE-000638

Applicant: RR Bussard Power Distribution Equipment Manufacturing LLC, Plot no. 597
4904, Warehouse No. 4, Near Pepsi Bottlers, OP 2, Dubai, U.A.E.

Apparatus: 5000A, 1794H, 1000V/2000V(BV (U_A/U_N)), 50Hz (U_n = 4750A @ 60Hz), double-stack busbar trunking system, with class I epoxy coated and painted copper busbars with outer layer polyester wrapped in an aluminium enclosure comprising of two flanged ends, two straight lengths and three corner sections.

**RR Bussard Power Distribution Equipment Manufacturing LLC, Plot no. 597
4904, Warehouse No. 4, Near Pepsi Bottlers, OP 2, Dubai, U.A.E.**

Manufactured By:

Test Report No: 01000336-9

Designation: RRP500CVGULR6 / GUARDED PLUS

The apparatus which is representative of the designation, supplied drawings and photographs has been examined in accordance with:

IEC 61439-6: Edition 1.0 2012-05 Clauses 10.2, 10.3, 10.4, 10.5, 10.9, 10.10, 10.11, 10.12 and Annex B

Verification with reference to the tests listed in Annex D of IEC 61439-6: Edition 1.0 2012-05

1.	Strength of material and parts	6/7/8:	No verification by testing required
2.	Degree of protection of enclosures	9:	Dielectric properties
3.	Clearances	10:	Temperature and limits
4.	Crawproof distances	11:	Short circuit without strength
5.	Protection against electric shock and integrity of protective circuits	12:	Electromagnetic compatibility (EMC)

Annex BB : Phase conductor characteristics

The results are shown in the record of tests attached herewith. The values obtained and the general performance is considered to comply with the above Standard(s) and to justify the ratings assigned by the manufacturer as stated on the ratings page(s) of this Certificate. This Certificate applies only to the apparatus tested. Responsibility for conformity of any apparatus bearing the name or other designations rests with the Manufacturer.

010

[Signature]

5th January 2021

Certification Engineer
Certification Officer

Date

PRODUCT CERTIFICATION

Intertek Certificate No. 21508

ASTA Certificate of Verification Tests

Laboratory Ref. No: WO-1718-007464 / WO-1718-007790 / ERDA-00212076, WO-1718-011625 / ERDA-00222179 and WO-1718-012678 / ERDA-00224906

APPARATUS: 800A, TPNHE, 1000V/1000V/8kV (LULU/LULU), 50/60Hz single stack sandwich busbar trunking system, with polyester wrapped in plated copper busbars (with polyester tape wrapped at the ends) in an aluminum enclosure comprising of two flanged ends, two straight lengths and three joint sections.

DESIGNATION: RR250CPHSFLU65 / GUARDEX

MANUFACTURER: RR Busduct Power Distribution Equipment Manufacturing LLC, Plot No. 597 4904, Warehouse No. 4, Near Pepsi Bottlers, DIP 2, Dubai, U.A.E.

TESTED BY: Electrical Research & Development Association, ERDA Road, Makarapura Industrial Estate, Vadodra-390 010, Gujarat, INDIA

DATES OF TESTS: 8th August 2017 to 30th November 2017.

The apparatus, constructed in accordance with the description, drawings and photographs incorporated in this certificate has been subjected to the series of proving tests in accordance with

IEC 61439-6: Edition 1.0 2012-05

Verifications with reference to the tests listed in Annex D of IEC 61439-1: Edition 1.0 2012-05

1. Strength of materials and parts
2. Degree of protection
3. Clearances
4. Creepage distances
5. Protection against electric shock
9. Dielectric properties
10. Temperature-rise
11. Short-circuit withstand strength
12. Electromagnetic Compatibility
13. Mechanical operation

For ratings assigned by the manufacturer and verified by test see rating pages A and B

The results are shown in the record of Proving Tests attached hereto. The values obtained and the general performance is considered to comply with the above Standard(s) and to justify the ratings assigned by the manufacturer as stated on the ratings page(s).

This certificate applies only to the apparatus tested. Responsibility for conformity of any apparatus having the same or other designations rests with the Manufacturer.

This certificate comprises this front sheet, 2 ratings pages plus 22 other pages as detailed on pages 2

Only integral reproductions of this whole certificate or reproductions of this page accompanied by any ratings pages are permitted. Issued by Intertek, Centre Court, Meridian Business Park, Leicester LE19 1WD, United Kingdom. Contact: astac@intertek.com Tel: +44 (0)116 263 0330

P Gibbons
ASTA Observer
Certification Manager
20th December 2017 Date

UKAS
010

Intertek Certificate No. 21585

ASTA Certificate of Selected Verification Tests

Laboratory Ref. No: P108142-1000

APPARATUS: 2500A, TPNHE, double stack sandwich busbar trunking system, with polyester wrapped in plated copper busbars in an aluminum enclosure comprising of one straight length.

DESIGNATION: RR250CPHSFLU65 / GUARDEX

MANUFACTURER: RR Busduct Power Distribution Equipment Manufacturing LLC, Plot No. 597 4904, Warehouse No. 4, Near Pepsi Bottlers, DIP 2, Dubai, U.A.E.

TESTED BY: BRE Global Ltd, Bucknalls Lane, Watford, Herts WD25 9XQ, UK

DATES OF TESTS: 20th September 2017

The apparatus, constructed in accordance with the description, drawings and photographs incorporated in this certificate has been subjected to the series of proving tests in accordance with

IEC 61439-6: Edition 1.0 2012-05 Clause 10.102

Verifications with reference to the tests listed in Annex D of IEC 61439-6: Edition 1.0 2012-05

The results are shown in the record of Proving Tests attached hereto. The values obtained and the general performance is considered to comply with the above Standard(s) and to justify the ratings assigned by the manufacturer as stated on the ratings page(s).

Fire resistance in building penetrations: 240 minutes

This certificate applies only to the apparatus tested. Responsibility for conformity of any apparatus having the same or other designations rests with the Manufacturer.

This certificate comprises this front sheet and 20 other pages as detailed on page A

Only integral reproductions of this whole certificate or reproductions of this page accompanied by any ratings pages are permitted. Issued by Intertek, Centre Court, Meridian Business Park, Leicester LE19 1WD, United Kingdom. Contact: astac@intertek.com Tel: +44 (0)116 263 0330

Rajani Menon
ASTA Observer
Certification Manager
28th March 2018 Date

UKAS
010

Intertek Certificate No. 21608

ASTA Certificate of Selected Verification Tests

Laboratory Ref. No: P108438-1001

APPARATUS: 1400A, TPNHE, single stack sandwich busbar trunking system, with polyester wrapped in plated copper busbars in an aluminum enclosure comprising of two straight lengths, one joint section and a protective circuit.

DESIGNATION: RR140CPHSFLU65 / GUARDEX

MANUFACTURER: RR Busduct Power Distribution Equipment Manufacturing LLC, Plot No. 597 4904, Warehouse No. 4, Near Pepsi Bottlers, DIP 2, Dubai, U.A.E.

TESTED BY: BRE Global Ltd, Bucknalls Lane, Watford, Herts WD25 9XQ, UK

DATES OF TESTS: 20th and 27th September 2017

The apparatus, constructed in accordance with the description, drawings and photographs incorporated in this certificate has been subjected to the series of proving tests in accordance with

IEC 61439-6: Edition 1.0 2012-05 Clause 10.101

Verifications with reference to the tests listed in Annex D of IEC 61439-6: Edition 1.0 2012-05

The results are shown in the record of Proving Tests attached hereto. The values obtained and the general performance is considered to comply with the above Standard(s) and to justify the ratings assigned by the manufacturer as stated on the ratings page(s).

14. Resistance to Flame propagation

This certificate applies only to the apparatus tested. Responsibility for conformity of any apparatus having the same or other designations rests with the Manufacturer.

This certificate comprises this front sheet and 21 other pages including 5 drawings as detailed on page A

Only integral reproductions of this whole certificate or reproductions of this page accompanied by any ratings pages are permitted. Issued by Intertek, Centre Court, Meridian Business Park, Leicester LE19 1WD, United Kingdom. Contact: astac@intertek.com Tel: +44 (0)116 263 0330

Rajani Menon
ASTA Observer
Certification Manager
16th April 2018 Date

UKAS
010

FACTORY CERTIFICATION

Intertek
Total Quality Assurance

CERTIFICATE OF REGISTRATION

This is to certify that the management system of:

RR BUSDUCT POWER DISTRIBUTION EQUIPMENT MANUFACTURING LLC

Main Site: Plot No. 597 4904, Warehouse No. 4, Near Pepsi Bottler, DIP-2 P.O. Box31680, Dubai, United Arab Emirates

has been registered by Intertek as conforming to the requirements of:

ISO 14001:2015

The management system is applicable to:

Design and Manufacturing of Low Voltage Bus Bar Trunking Systems (busways) and Electrical Switchgear.

Certificate Number: QMS 171029-01
Initial Certification Date: 27 October 2017
Date of Certification Decision: 27 October 2017
Issuing Date: 27 October 2017
Valid Until: 26 October 2020

Calin Moldovean
President, Business Assurance
Intertek Certification Limited, 32A Victory Park, Victory Road, Derby DE24 8DT, United Kingdom
Intertek Certification Limited is a UKAS accredited body under schedule of accreditation no. 054.

UKAS
054

Intertek
Total Quality Assurance

CERTIFICATE OF REGISTRATION

This is to certify that the management system of:

RR BUSDUCT POWER DISTRIBUTION EQUIPMENT MANUFACTURING LLC

Main Site: Plot No. 597 4904, Warehouse No. 4, Near Pepsi Bottler, DIP-2 P.O. Box31680, Dubai, United Arab Emirates

has been registered by Intertek as conforming to the requirements of:

ISO 9001:2015

The management system is applicable to:

Design and Manufacturing of Low Voltage Bus Bar Trunking Systems (busways) and Electrical Switchgear.

Certificate Number: QMS 171029-01
Initial Certification Date: 27 October 2017
Date of Certification Decision: 27 October 2017
Issuing Date: 27 October 2017
Valid Until: 26 October 2020

Calin Moldovean
President, Business Assurance
Intertek Certification Limited, 32A Victory Park, Victory Road, Derby DE24 8DT, United Kingdom
Intertek Certification Limited is a UKAS accredited body under schedule of accreditation no. 054.

UKAS
054

Intertek
Total Quality Assurance

CERTIFICATE OF REGISTRATION

This is to certify that the management system of:

RR BUSDUCT POWER DISTRIBUTION EQUIPMENT MANUFACTURING LLC

Main Site: Plot No. 597 4904, Warehouse No. 4, Near Pepsi Bottler, DIP-2 P.O. Box31680, Dubai, United Arab Emirates

has been registered by Intertek as conforming to the requirements of:

OHSAS 18001:2007

The management system is applicable to:

Design and Manufacturing of Low Voltage Bus Bar Trunking Systems (busways) and Electrical Switchgear.

Certificate Number: QMS 171029-01
Initial Certification Date: 27 October 2017
Date of Certification Decision: 27 October 2017
Issuing Date: 27 October 2017
Valid Until: 26 October 2020

Calin Moldovean
President, Business Assurance
Intertek Certification Limited, 32A Victory Park, Victory Road, Derby DE24 8DT, United Kingdom
Intertek Certification Limited is a UKAS accredited body under schedule of accreditation no. 054.

UKAS
054

EAC CERTIFICATE (GOST)

ТАМОЖЕННЫЙ СОЮЗ	
СЕРТИФИКАТ СООТВЕТСТВИЯ	
	№ TC RU C-AE.AY04.B.06067 Серия RU № 0720726
ОРГАН ПО СЕРТИФИКАЦИИ Общества с ограниченной ответственностью «Сертификация и экспертиза». Место нахождения: 109202, Российская Федерация, город Москва, улица Басовская, дом 16, строение 1, этаж 6, помещение IX, комната № 43. Адрес места осуществления деятельности: 117420, Российская Федерация, город Москва, улица Профсоюзная, дом 57. Телефон: +7 (495) 506-11-60, адрес электронной почты: info@certexp.ru. Аттестат аккредитации регистрационный № РОСС RU.0001.10AY04 выдан 13.03.2018 года	
ЗАЯВИТЕЛЬ Общество с ограниченной ответственностью «Уорлдуайдбридж». Место нахождения: 119270, Российская Федерация, город Москва, Лужнецкая набережная, дом 2/4, строение 3, офис 104. Основной государственный регистрационный номер: 1177746256676. Телефон: +74957878770, адрес электронной почты: info@wwbridge.org	
ИЗГОТОВИТЕЛЬ «RR Busduct Power Distribution Equipment Manufacturing LLC» Место нахождения и адрес места осуществления деятельности по изготовлению продукции: Dubai Investment Park - 2 – Dubai, Объединенные Арабские Эмираты	
ПРОДУКЦИЯ Соединители электрические промышленного назначения: шинопроводы, тип Guardex Busway System Продукция изготовлена в соответствии с Директивой 2014/35/EU «Низковольтное оборудование» Серийный выпуск	
КОД ТН ВЭД ТС 8536 90	
СООТВЕТСТВУЕТ ТРЕБОВАНИЯМ ТЕХНИЧЕСКОГО РЕГЛАМЕНТА ТАМОЖЕННОГО СОЮЗА: ТР ТС 004/2011 «О БЕЗОПАСНОСТИ НИЗКОВОЛЬТНОГО ОБОРУДОВАНИЯ»	
СЕРТИФИКАТ ВЫДАН НА ОСНОВАНИИ - протокола испытаний от 05.07.2018 года № 02129-215-1-18/БМ Испытательной лаборатории Общества с ограниченной ответственностью «Инновационные решения», аттестат аккредитации регистрационный № РОСС RU.0001.21AB90; - акта анализа состояния производства от 06.07.2018 года № 4313; - руководства по эксплуатации; Схема сертификации: 1с	
ДОПОЛНИТЕЛЬНАЯ ИНФОРМАЦИЯ Условия и сроки хранения продукции, срок службы (годности) указаны в прилагаемой к продукции эксплуатационной документации. Стандарты, в результате применения которых на добровольной основе обеспечивается соблюдение требований технического регламента: ГОСТ 12.2.007-0-75 «Система стандартов безопасности труда. Изделия электротехнические. Общие требования безопасности»	
СРОК ДЕЙСТВИЯ С 09.07.2018 ПО 08.07.2023 ВКЛЮЧИТЕЛЬНО	
	Руководитель (уполномоченное лицо) органа по сертификации Эксперт (эксперт-аудитор) (эксперты (эксперты-аудиторы)) Ефремова Анастасия Анатольевна (инициалы, фамилия) Лазарева Лидия Николаевна (инициалы, фамилия)

Бланк изготовлен ЗАО "ОПЦИОН" www.opcion.ru (лицензия № 05-05-09/003 ФНС РФ) тел. (495) 726 4742, Москва, 2013

RR BUSDUCT SYSTEMS SPECIFICATIONS

Certification & Standards

The equipment covered by this specification shall unless otherwise stated, be designed, constructed and tested in accordance with the latest revision of relevant International Standards.

IEC 61439-6	: Low Voltage Switchgear and Control Gear Assemblies-Busbar Trunking Systems
IEC 60331-1	: Circuit Integrity Test for Fire Rated Applications
IEC 60332 Prt-3	: Resistance to Flame Propagation
IEC 60695 Prt-2	: Resistance of the Materials to Abnormal Heat
IEC 60529	: Degree of Ingress Protection
IEEE 693	: Recommended Practice for Seismic Design of Substations
ISO 9001:2015	: Quality Management System

Busbar system shall be tested at independent internationally accredited laboratory (ASTA) for below tests and have a third party quality control certification (ASTA DIAMOND):

- Verification of Temperature Rise Limits
 - Verification of Dielectric Properties
 - Verification of Short Circuit Withstand Strength
 - Verification of Effectiveness of The Protective Circuit
 - Verification of Clearance & Creepage Distances
 - Verification of Mechanical Operation
 - Verification of Ability to Withstand Mechanical Loads
 - Verification of Degree of Protection
 - EMC Tests (not applicable)
 - Verification of Resistance of Insulating Materials to Abnormal Heat and Fire
 - Verification of Electrical Characteristics
 - Verification of Structural Strength
 - Verification of Crushing Resistance
 - Verification of Resistance to Flame Propagation
 - Verification of Fire Resistance in Building Penetration
-
- Busbar system shall include a CE MARK on its labels in accordance with the LV directive number 2014/35/EU.
 - The system shall confirm the Seismic requirement for Zone-5 as per IEEE 693 & tested by third-party lab (CPRI).
 - The system shall confirm the circuit integrity for Fire Rated application as per IEC 60331-1 (200 minutes) and tested by third party lab, UL.
 - Products shall be individually labelled and indicate brand, series, electrical details and manufacturing date.
 - The manufacturing facility to be certified by third party (Intertek) for Quality Management System (ISO 9001), Environmental (ISO 14001) and Health and Safety Standards (OHSAS 18001)

Electrical Characteristics:

- Busbar system Rated Operational Voltage U_e and Rated Insulation Voltage U_i shall be 1000V.
- Busbar trunking system shall be designed and manufactured to withstand minimum 50 kA r.m.s. symmetrical short circuit current of without damaging the electrical, mechanical and thermal stress under fault condition of the service voltage. The design shall be confirmed by providing the required type test certificates from ASTA Diamond.
- The continuous rated current shall be according to the designed load of each system and temperature compensated to the high ambient temperature at 50 Deg C.

Construction

- Shall be totally enclosed, non-ventilated design busbar and is fully insulated using halogen free, fire retardant Hybrid (Epoxy coating and Polyester film) Insulation.
- Enclosure material shall be Extruded Aluminium with epoxy powder coated with thickness not less than 3.0 mm and to be shaped in such a way as to give excellent electromechanical characteristic and heat dissipation and to guarantee total safety against contact with live parts.
- The construction shall be 'True Sandwich' System and also at the plug-in points. Conductors shall be so arranged in the enclosure with no air gap to achieve low reactance.
- Each plug-in opening shall be provided with automatic safety shutters to shield the live busbars.
- The construction of housing shall have four-part system, riveted by self-piercing rivets. Enclosure with nuts & bolts are not allowed.

Conductors

- The conductors shall be of high conductivity fully tin plated copper bars. Purity and conductivity of the busbar shall be:

Conductor Type		Purity	Conductivity
Copper	ETP Grade	>99.9%	>100% IACS
Aluminium	EC Grade	>99.5%	>59.5% IACS

- Aluminium / Copper conductors between phases shall be insulated with Epoxy Coating and Polyester Film Coating to minimum Class-F insulation.
 - Range for Copper Busbar System : 800A ~ 6300A
 - Range for Aluminium Busbar System : 800A ~ 5000A

Configuration Options

1. **3P+100%N*+Housing PE**
2. **3P+100%N*+50% Internal Earth**
3. **3P+200%N*+Housing PE**

** Neutral conductors shall be fully insulated and same cross-section of phase conductors. Other configurations are available upon request. **

Insulation

- Busbar shall be insulated with Class-F epoxy coated and polyester film (Hybrid Insulation) on the conductors. Insulation voltage shall not be less than 1000V.
- Joint plate insulation shall be minimum Class-F, UL 94-V0 Halogen free, Red Phosphorus free and complies with RoHS. Insulating material shall be self-extinguishing and non-fire propagating type.

Joint Construction

- Joints shall be monobloc with shear off nuts so that it shall be possible to remove Joints to allow electrical isolation or physical removal of a Busbar-trunking section without disturbing adjacent Busbar-trunking sections.
- A torque breaking nut (double head) to be used which can be break at pre-determined torque and Joint bolt to be tighten from one side only.
- The side joint shall be of extruded aluminum with cooling fins having minimum thickness of 5 mm.

Ingress Protection

Busbar Trunking System shall be totally enclosed and comply with degree of protection of at least IP65, as specified and defined in IEC 60529. The plug-in outlet and joint cover/plug-in tap off box should comply with IP55.

** Provide final protection to ensure that moisture does not enter bus assembly.*

Indoor Installation	IP65
Outdoor Installation*	IP65 / IP67
Plug-in Units	IP55

** Canopy is highly recommended to enhance product performance and life time .*

Accessories

- Standard range of accessories shall include Horizontal and Vertical elbows, T-Elements, Offsets, Expansion Joints, Phase Crossover Unit, Reducers, Connecting Elements to Switchgear / Transformer / Generator.
- The busbar system shall have standalone expansion element and be fitted at least every 40 mtrs of horizontal run and wherever busbars cross a building expansion.

Tap Off Boxes

- Shall be constructed from Galvanized Sheet Steel with paint finish.
- The tap off box should have hinged front cover. It shall incorporate an external operating handle with ON, OFF, TRIP indication for MCCB, enabling it to be operated with the cover closed.
- The MCCB shall incorporate padlocking facilities in OFF position for maintenance purpose. The plug-in units shall be suitable for mounting on front of the riser as required. The unit shall be supplied with all connections and accessories to enable connection to the busbars and the outgoings cable to be correctly and safely achieved.
- Tap off boxes shall be suitable for any brand of MCCBs.
- Shall be suitable for supplying three phase loads from 63A to 800A (plug-in type) and 1000A - 1200A (in-line type).
- The units shall have clamps with interlocking facility to prevent the unit being removed from the busbar when MCCB is in the ON position.
- The point at which tap off is connected to the busbar shall be formed (press tag) from the main conductor body.
- Additional interlock to be provided to prevent opening of the door of plug in when the MCCB is in the ON position.



RR BUSDUCT POWER DISTRIBUTION EQUIPMENT MANUFACTURING LLC

Plot No. 597-4904, Unit No. 4, Near Pepsi Bottlers, Dubai Investment Park 2 (DIP-2), P. O. Box 31680, Dubai-U.A.E.
T: +971-4-885 4340 • F: +971-4-885 4341 • E: rrbusduct@me-rrglobal.com

MENA OFFICE (MIDDLE EAST & NORTH AFRICA)

2903, 2904, 2905 & 2906, Iris Bay, Al Mustaqbal Street, Business Bay, Dubai-U.A.E.
T: +971-4-330 3466 • F: +971-4-330 1533 • E: rrelectrical@me-rrglobal.com

REGISTERED OFFICE

Ram Ratna House, Utopia City, P.B Marg, Worli, Mumbai-400 013, INDIA.
T: +91-22-2494 9009 / 2492 4144 • F: +91-22-2493 0203 / 2493 2339

www.rrglobal.com |   

The information & technical data mentioned in this brochure is true, complete and correct. However, the technical data could vary from time to time, hence, current details should always be checked with RR Global for accuracy.